



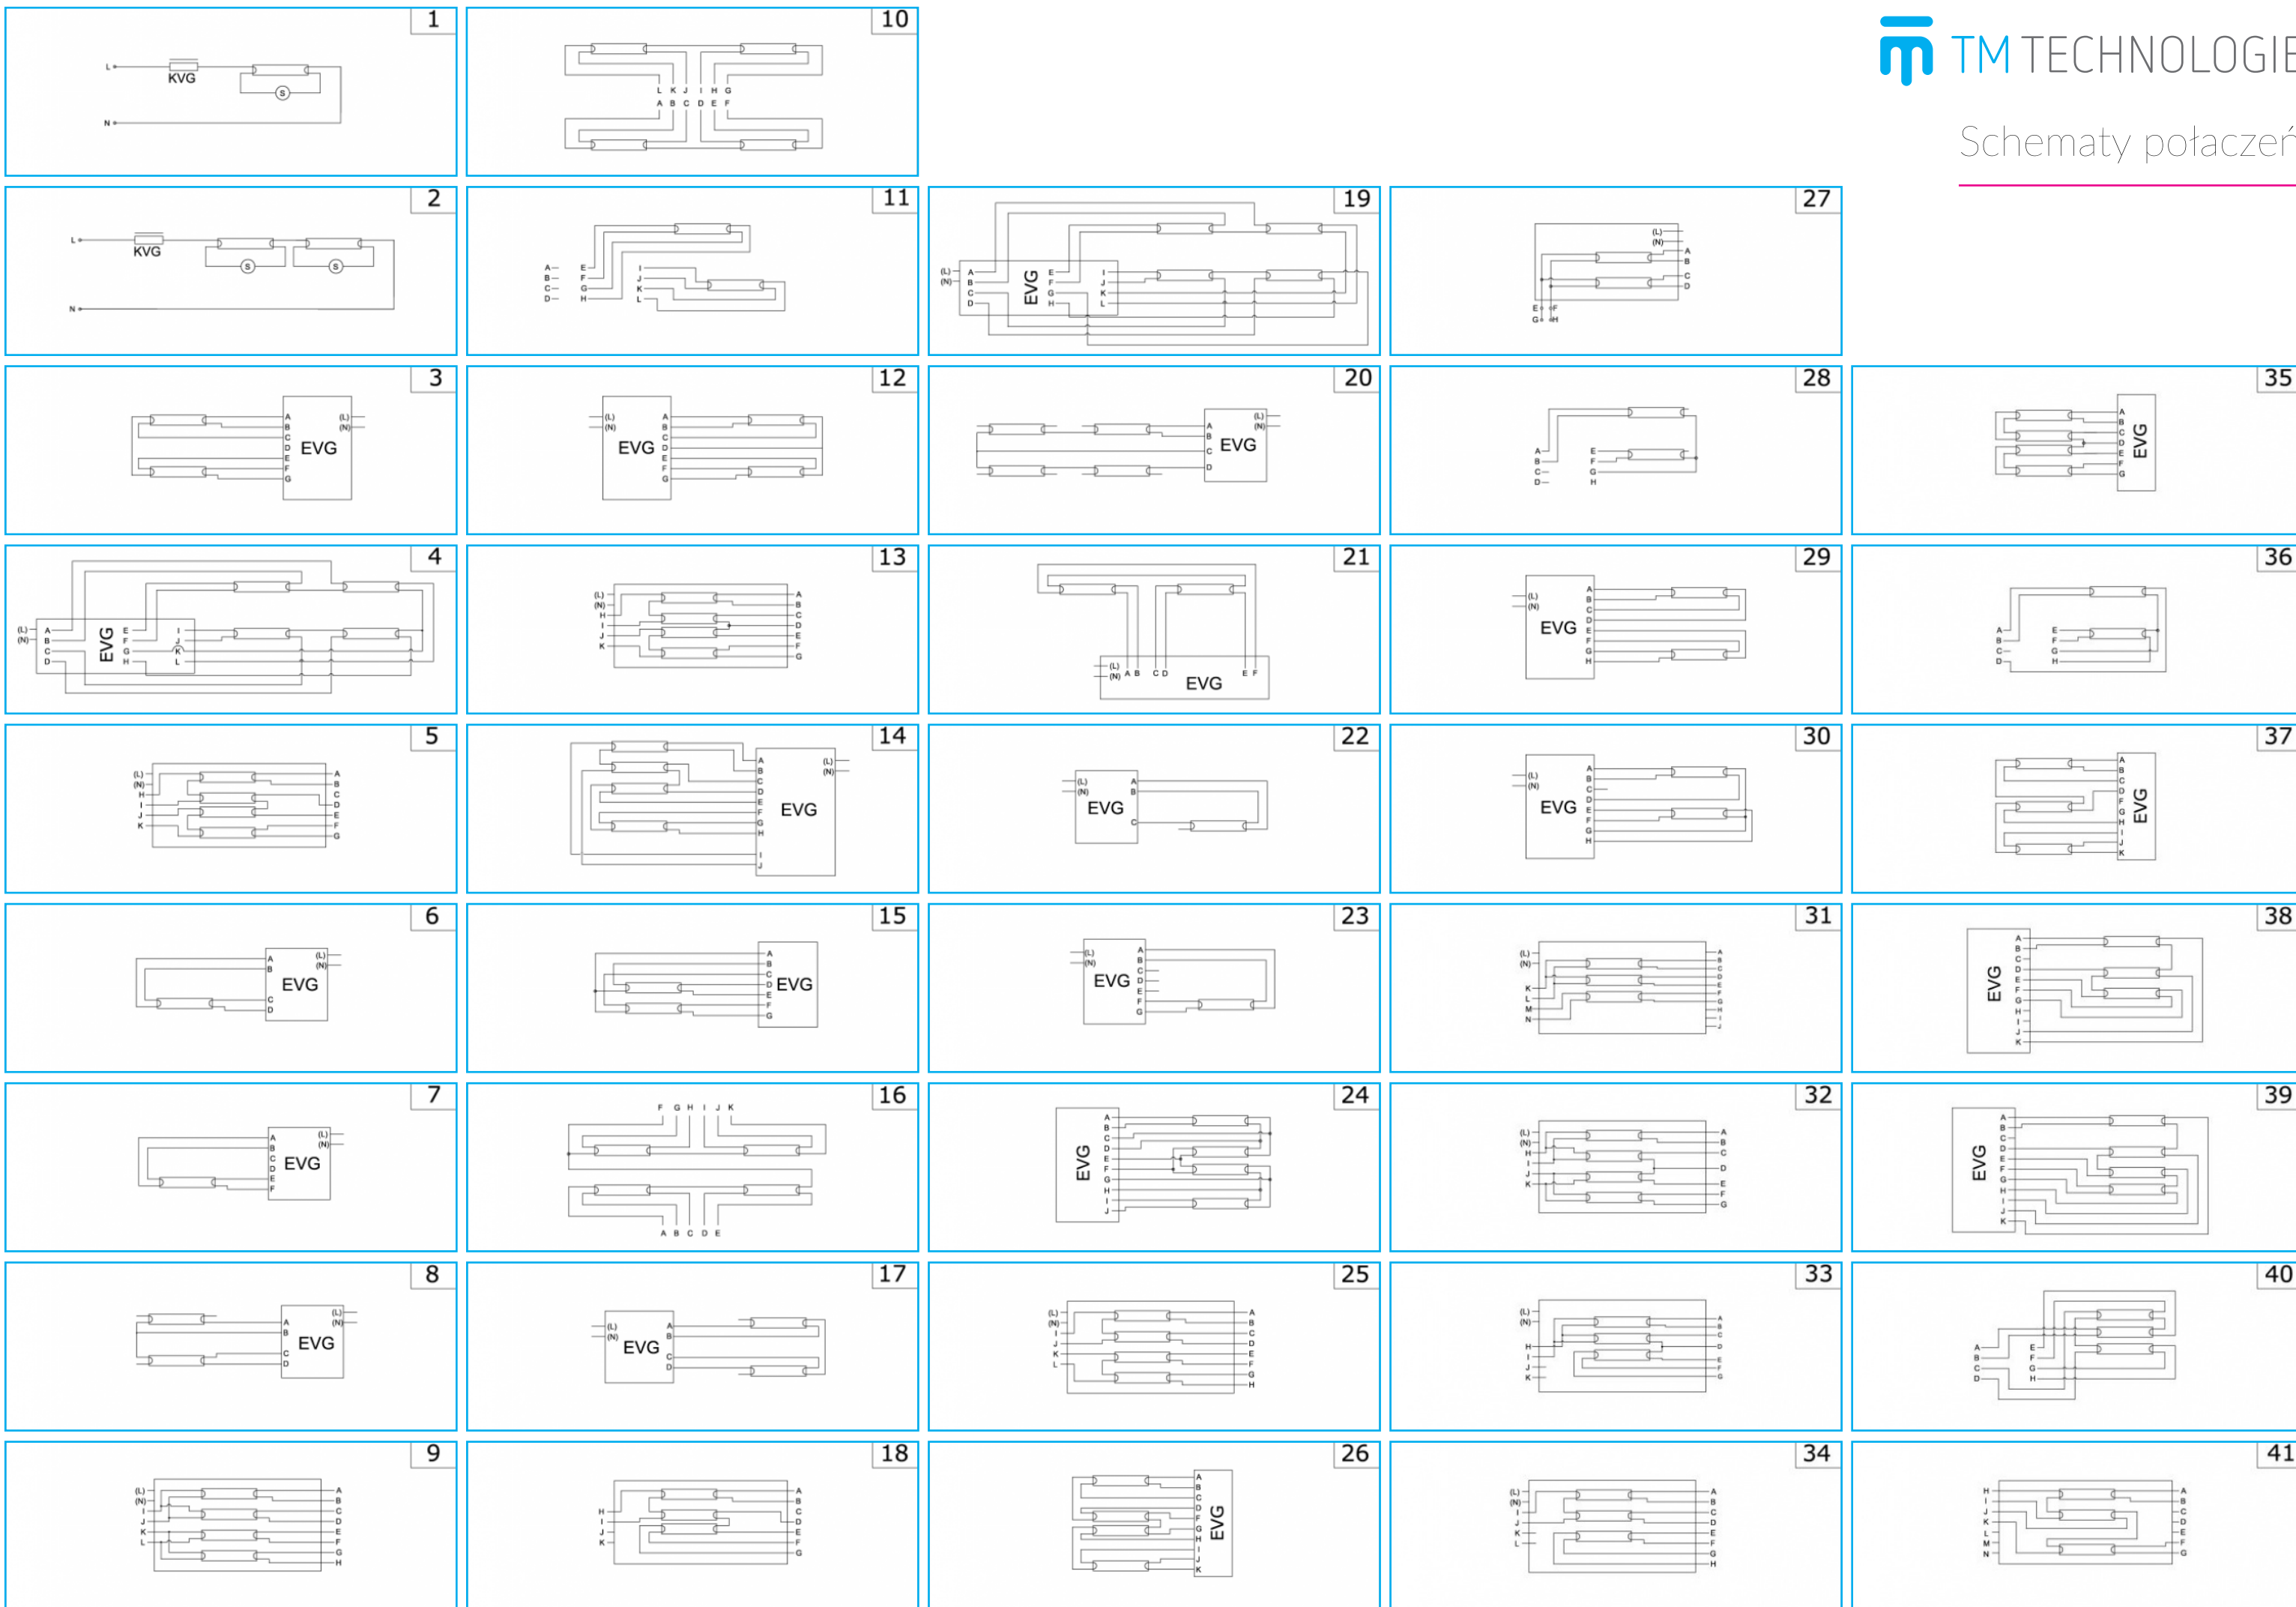

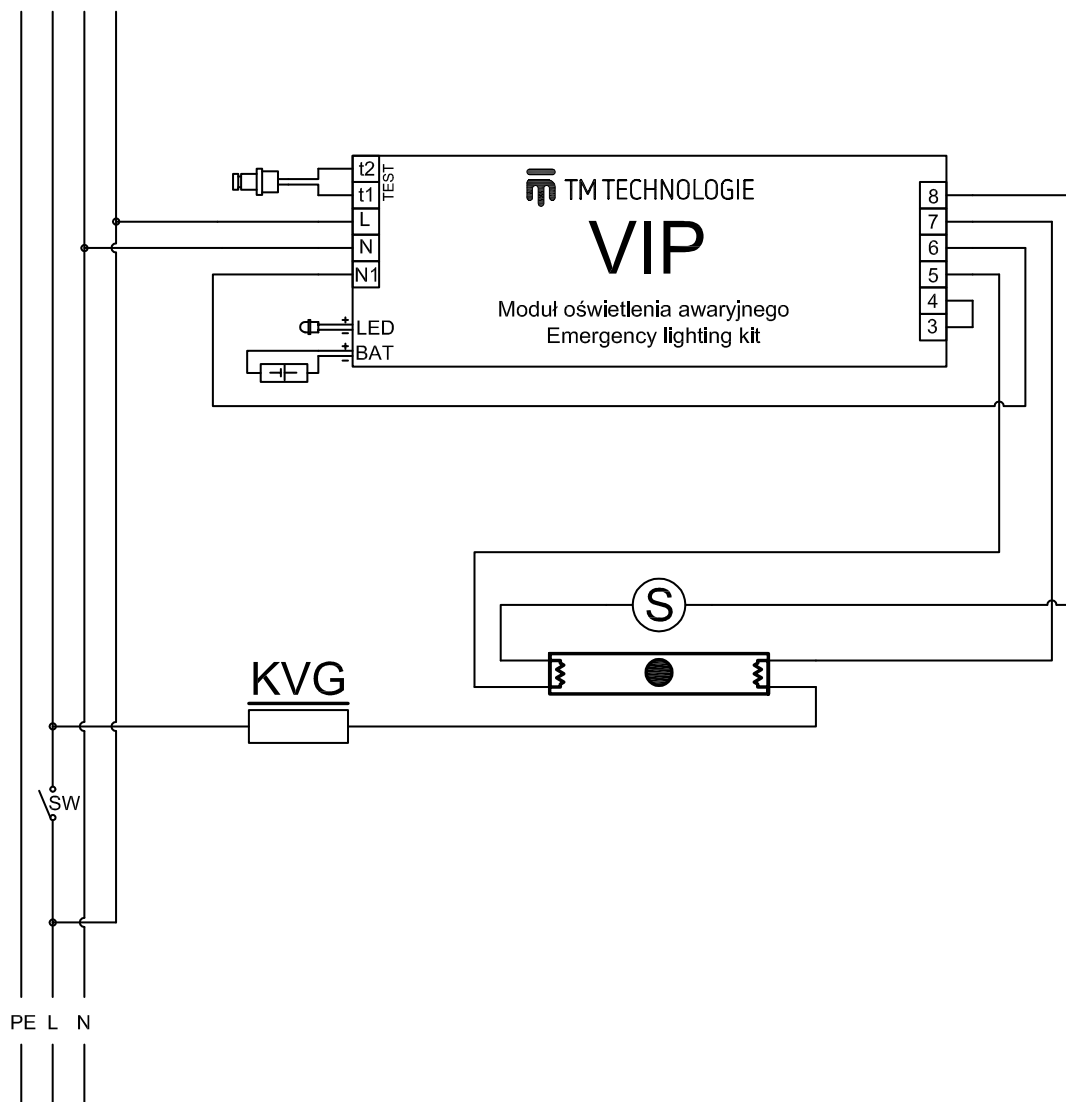

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	✓
VIP ST 2	
VIP ST i(e)	
VIP PRO i	
VIP PRO i AT	
VIP PRO i DATA	

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	001	TM TECHNOLOGIE
Wersja	01/2014	

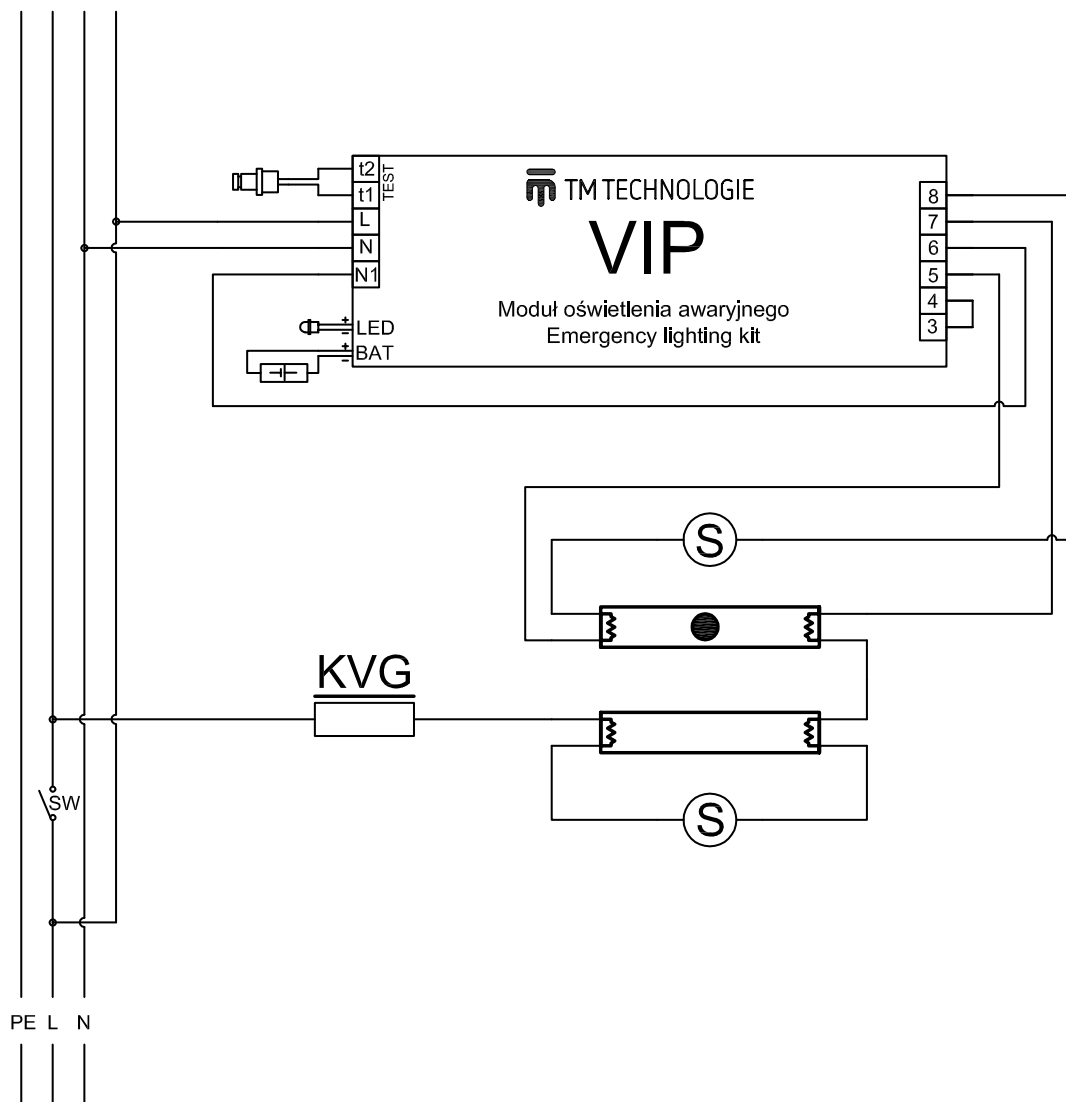

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	✓
VIP ST 2	
VIP ST i(e)	
VIP PRO i	
VIP PRO i AT	
VIP PRO i DATA	

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	002	TM TECHNOLOGIE
Wersja	01/2014	

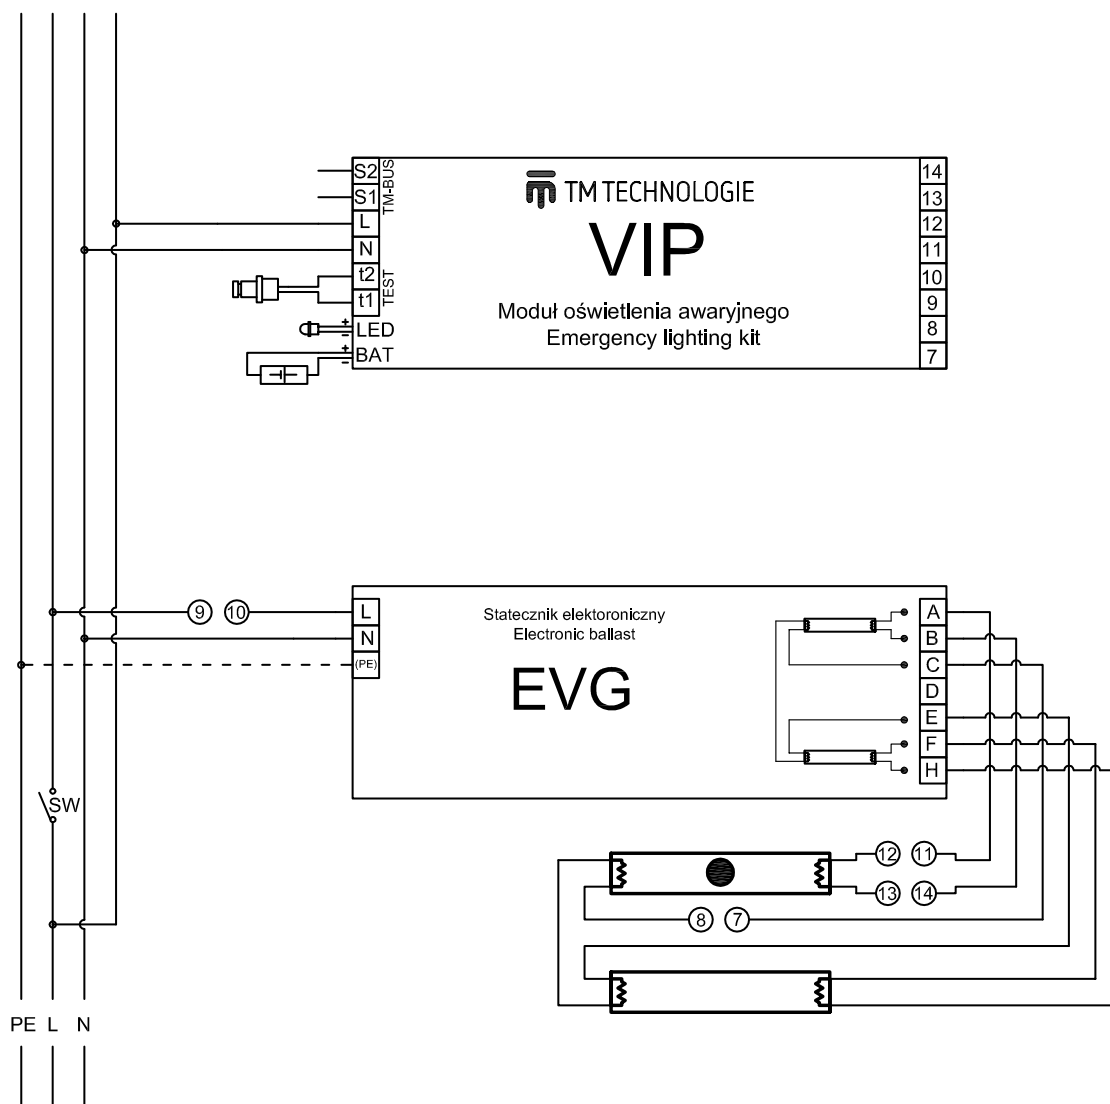

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,

● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),

S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),

⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.

Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.

Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.

Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.

Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,

● - fluorescent lamp working in maintained mode,

t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)

S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),

⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.

LED diode lead -length 90 or 30 cm. Black "+", black and red "-".

Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.

During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.

All connection leads should be as short as possible.

Please read the manual of VIP emergency lighting kit carefully before use.

Please test carefully your circuit after instalation. More details tel:

+48 12 444 60 60 ext. 60


NR. Schem.

003

Wersja

01/2014

TM TECHNOLOGIE

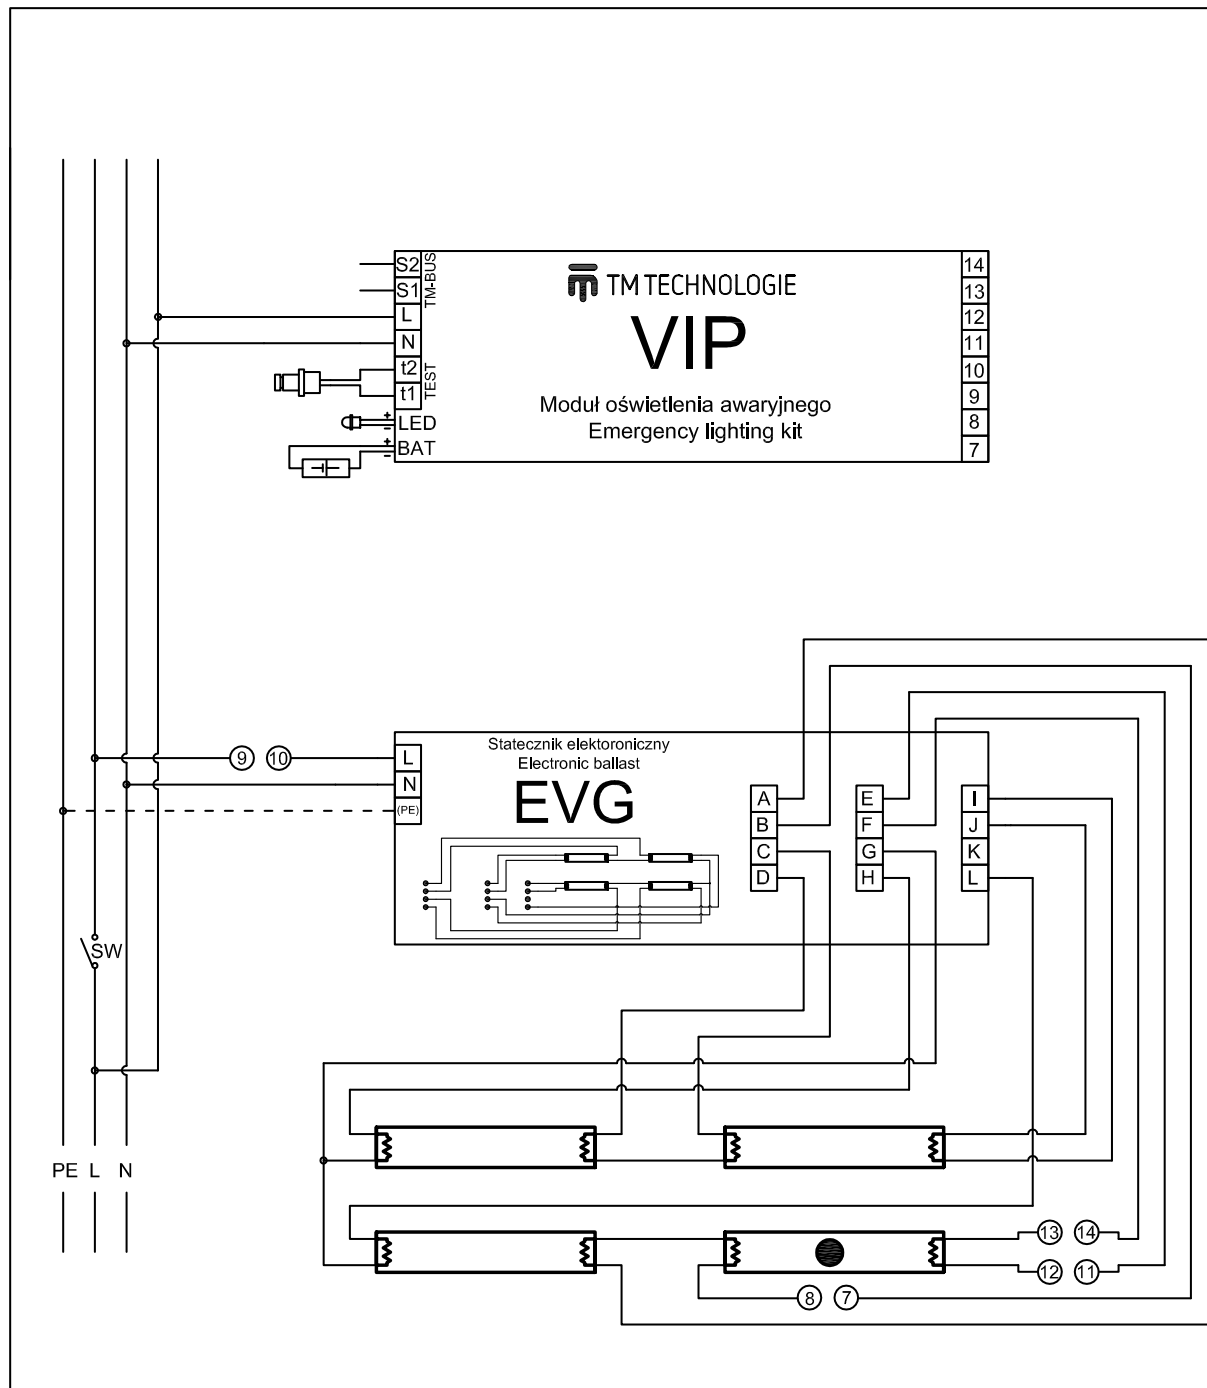

Schemat podłączenia modułów oświetlenia awaryjnego typu:
Connection schema of emergency lighting kits :

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,

● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),

S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),

⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.

Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.

Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.

Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.

Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,

● - fluorescent lamp working in maintained mode,

t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)

S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),

⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.

LED diode lead -length 90 or 30 cm. Black "+", black and red "-".

Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.

During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.

All connection leads should be as short as possible.

Please read the manual of VIP emergency lighting kit carefully before use. Please test carefully your circuit after instalation. More details tel:

+48 12 444 60 60 ext. 60


NR. Schem.

004

Wersja

01/2014

TM TECHNOLOGIE

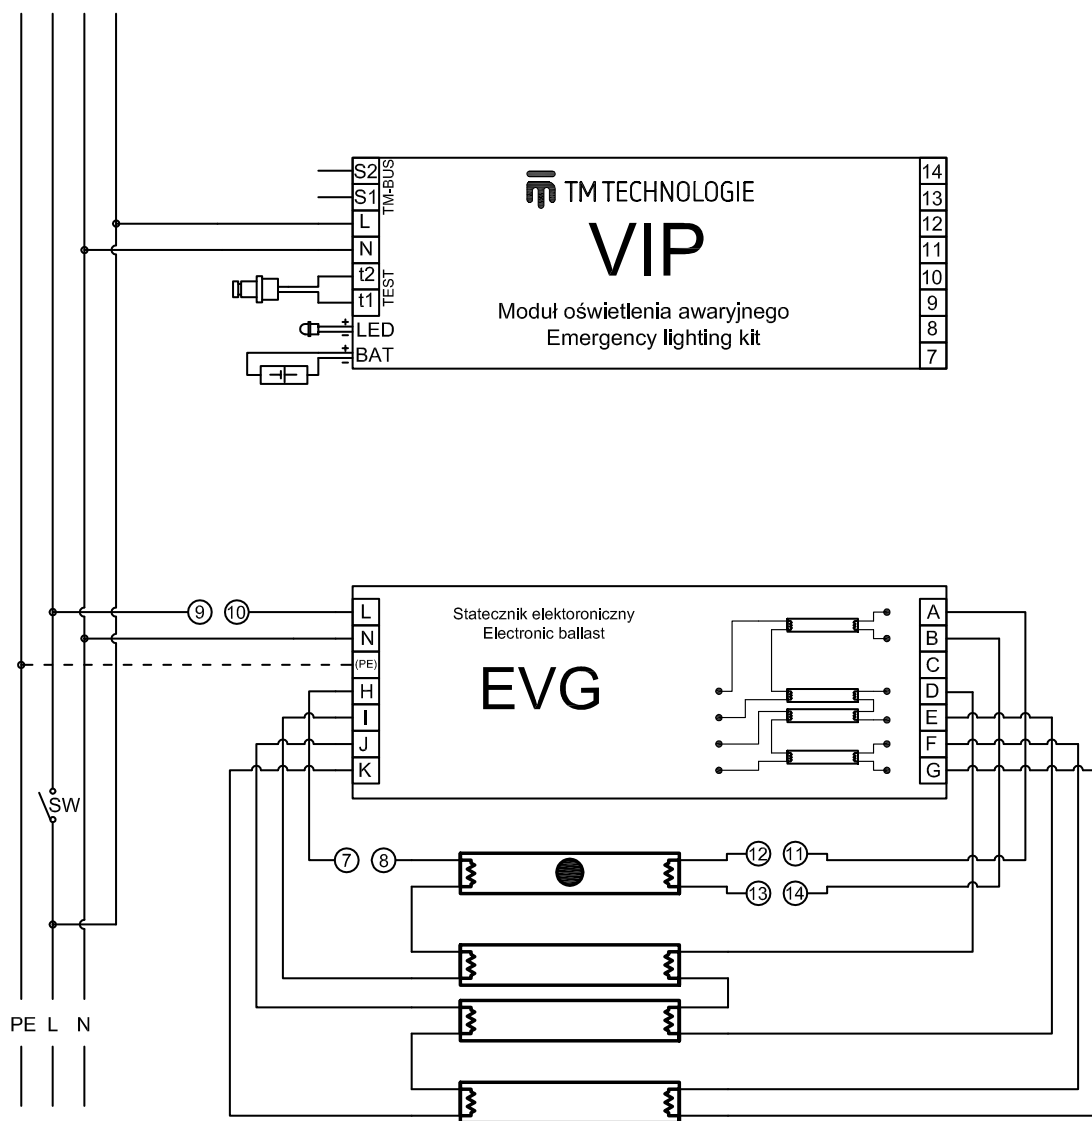

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,

● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),

S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),

⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.

Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.

Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.

Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.

Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,

● - fluorescent lamp working in maintained mode,

t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)

S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),

⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.

LED diode lead -length 90 or 30 cm. Black "+", black and red "-".

Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.

During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.

All connection leads should be as short as possible.

Please read the manual of VIP emergency lighting kit carefully before use. Please test carefully your circuit after instalation. More details tel:

+48 12 444 60 60 ext. 60


NR. Schem.

005

Wersja

01/2014

TM TECHNOLOGIE

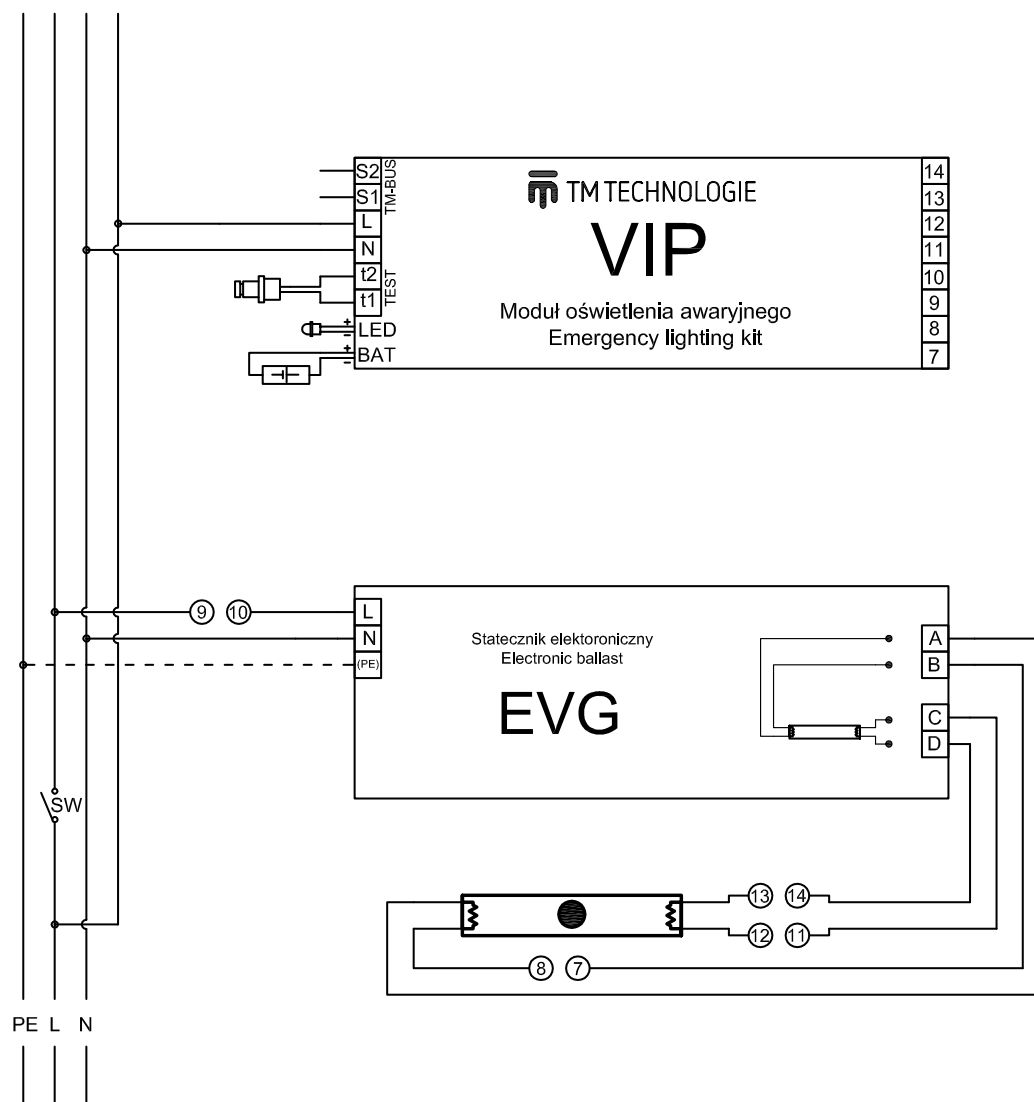

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	006	TM TECHNOLOGIE
Wersja	01/2014	

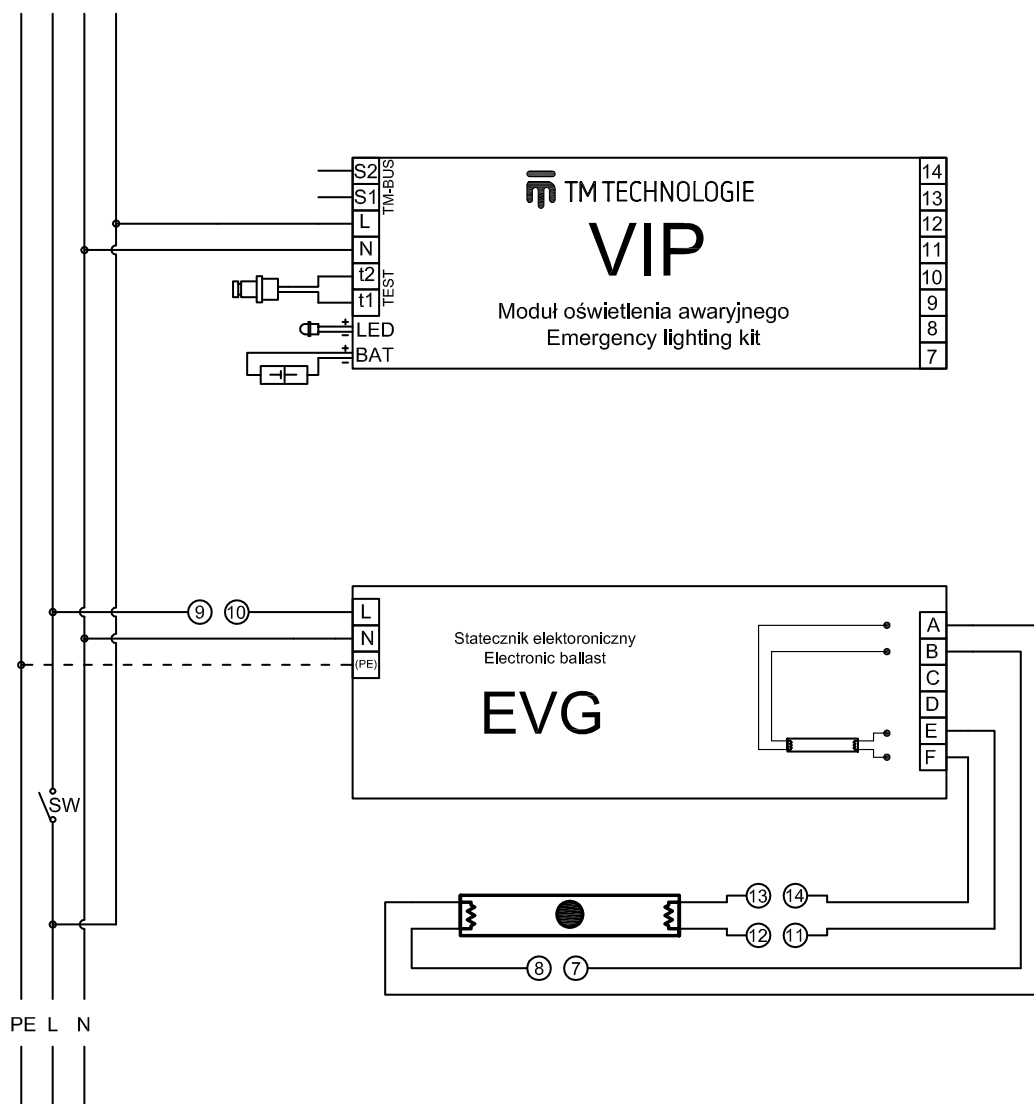

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	007	TM TECHNOLOGIE
Wersja	01/2014	

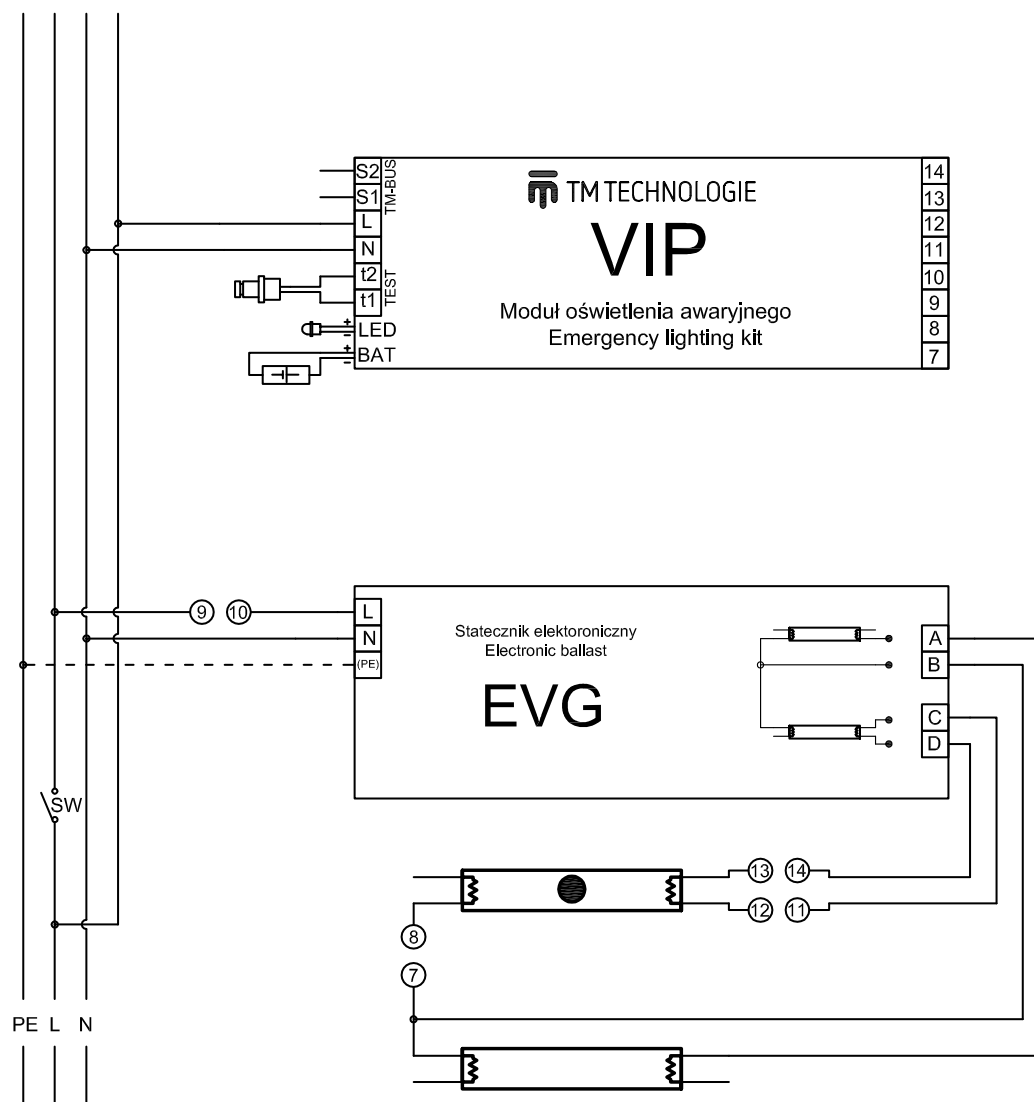

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	008	TM TECHNOLOGIE
Wersja	01/2014	

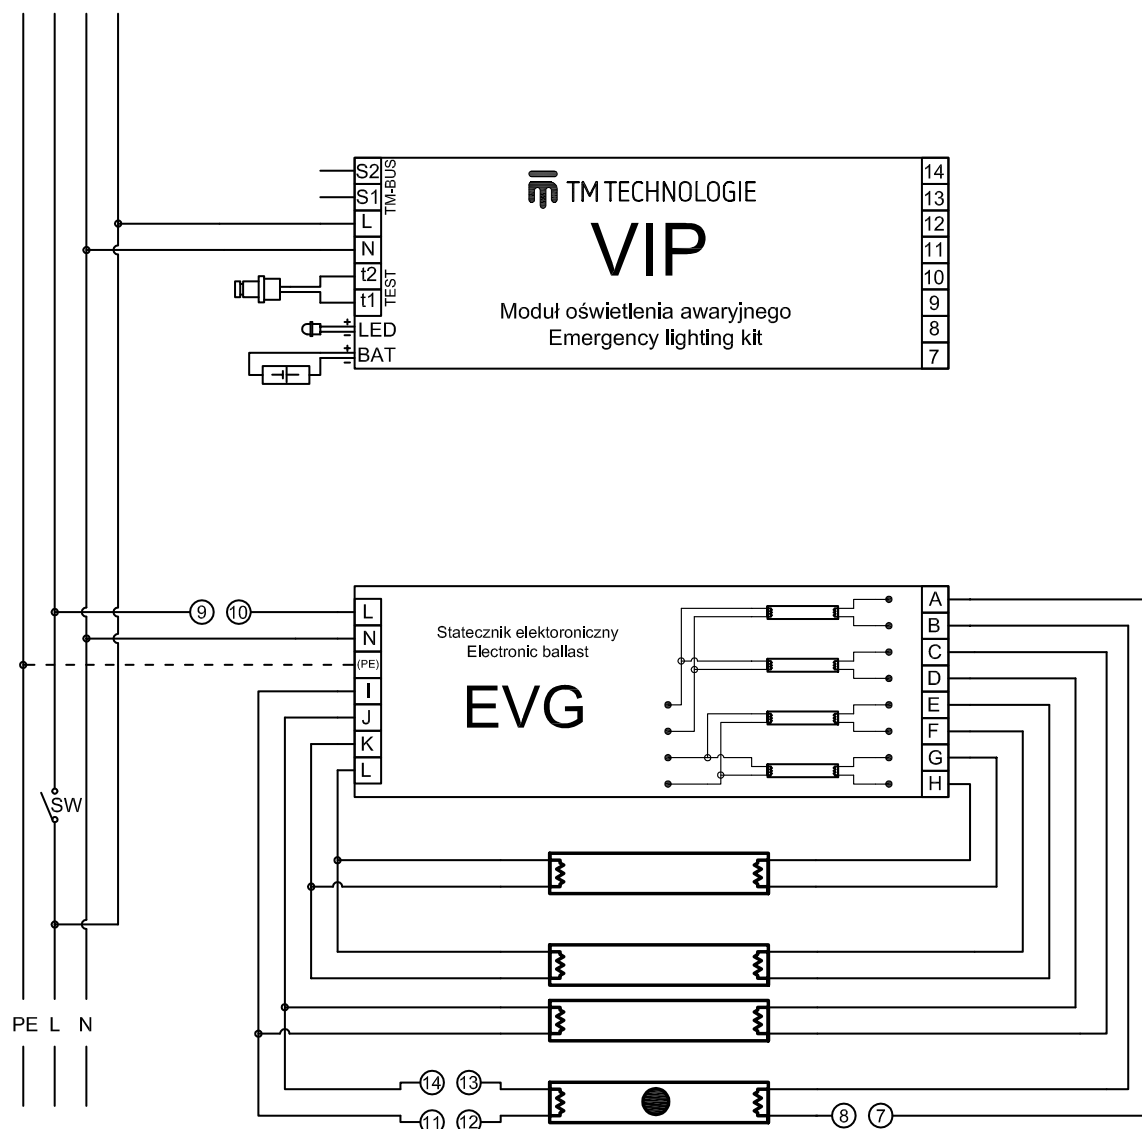

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	009	TM TECHNOLOGIE
Wersja	01/2014	

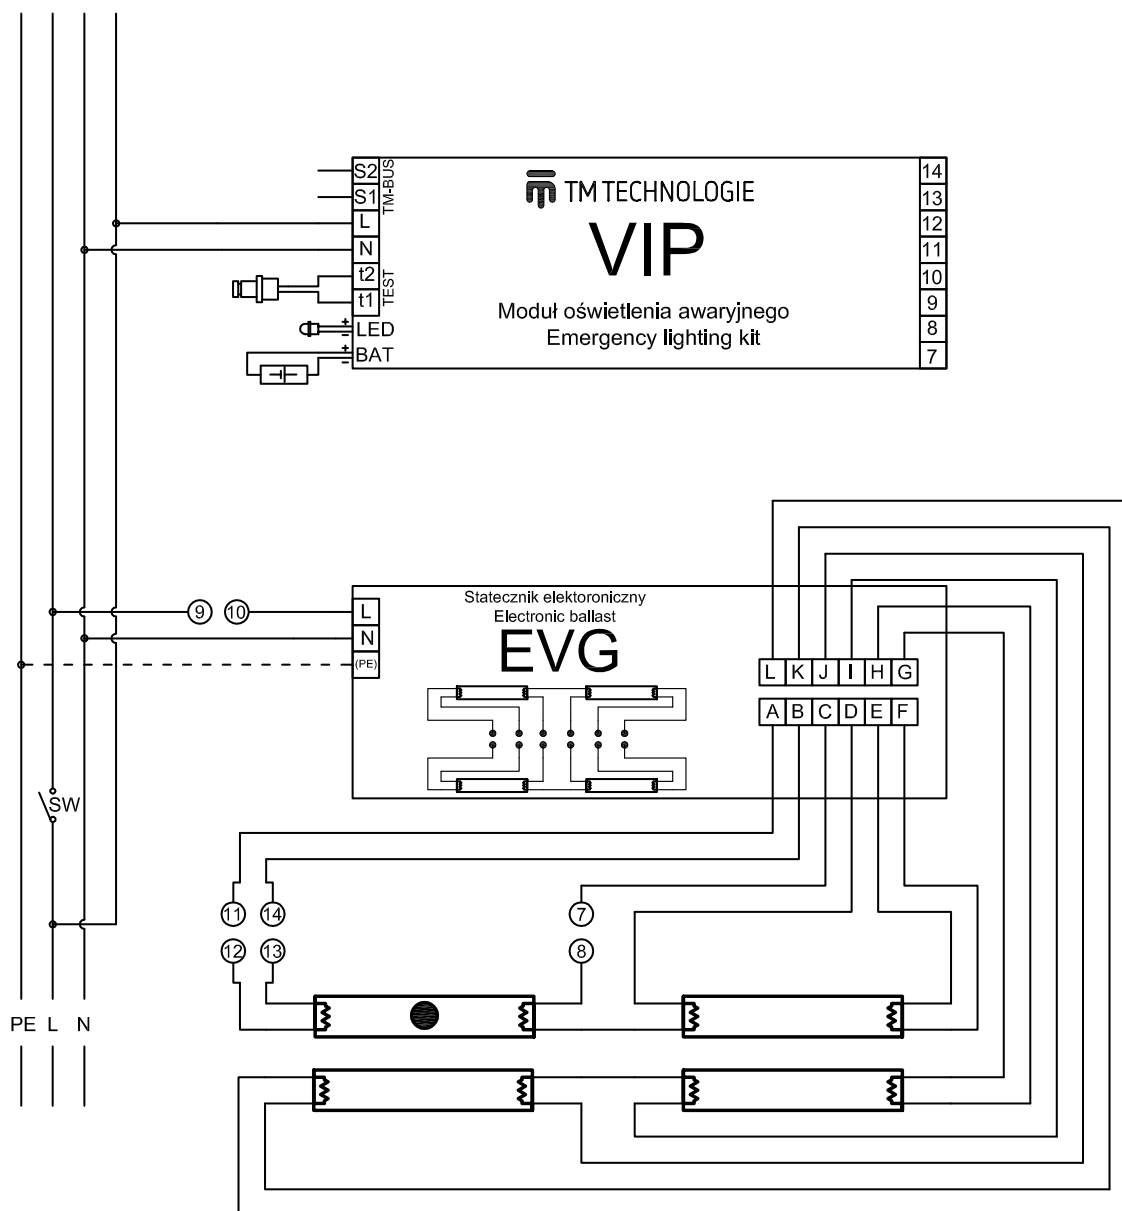

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	010	TM TECHNOLOGIE
Wersja	01/2014	

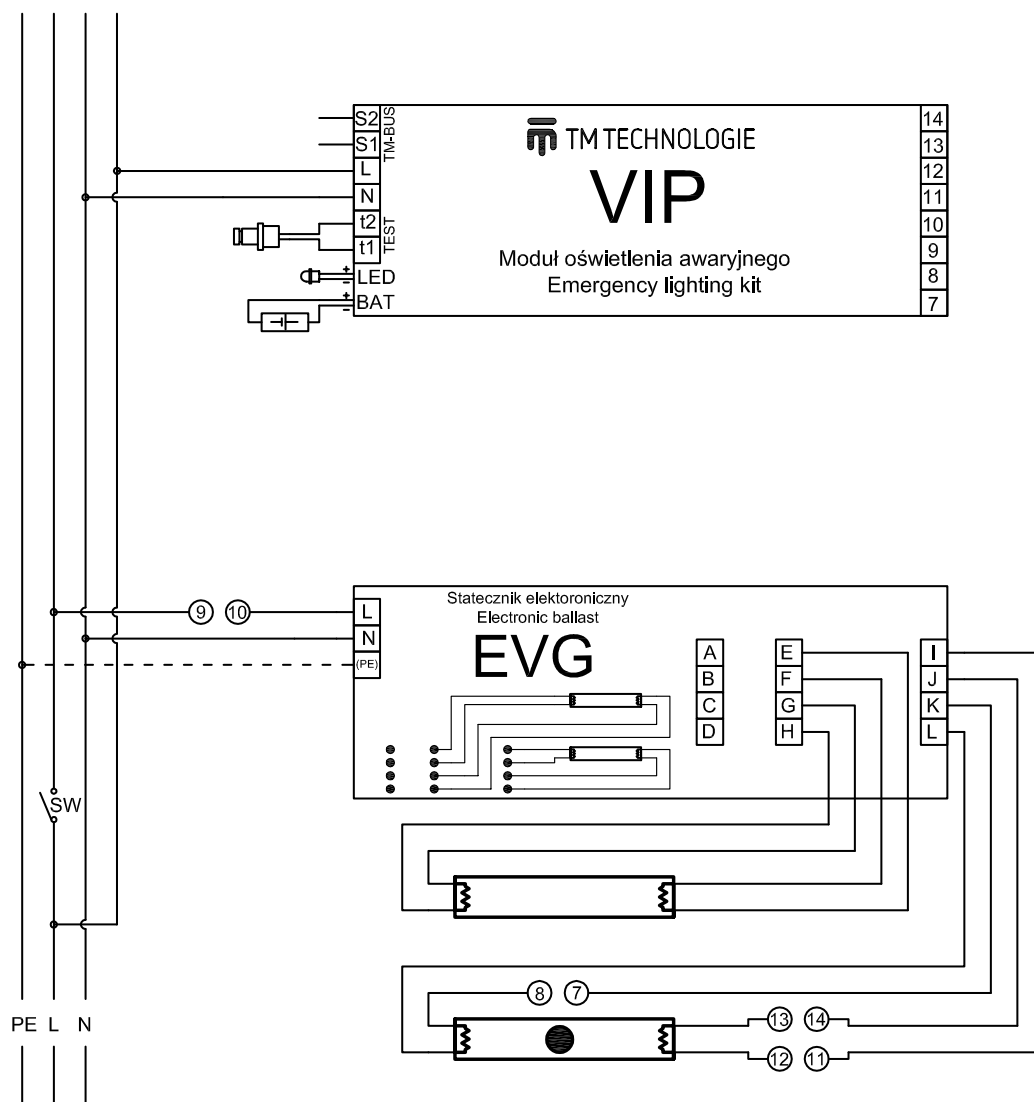

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	011	TM TECHNOLOGIE
Wersja	01/2014	

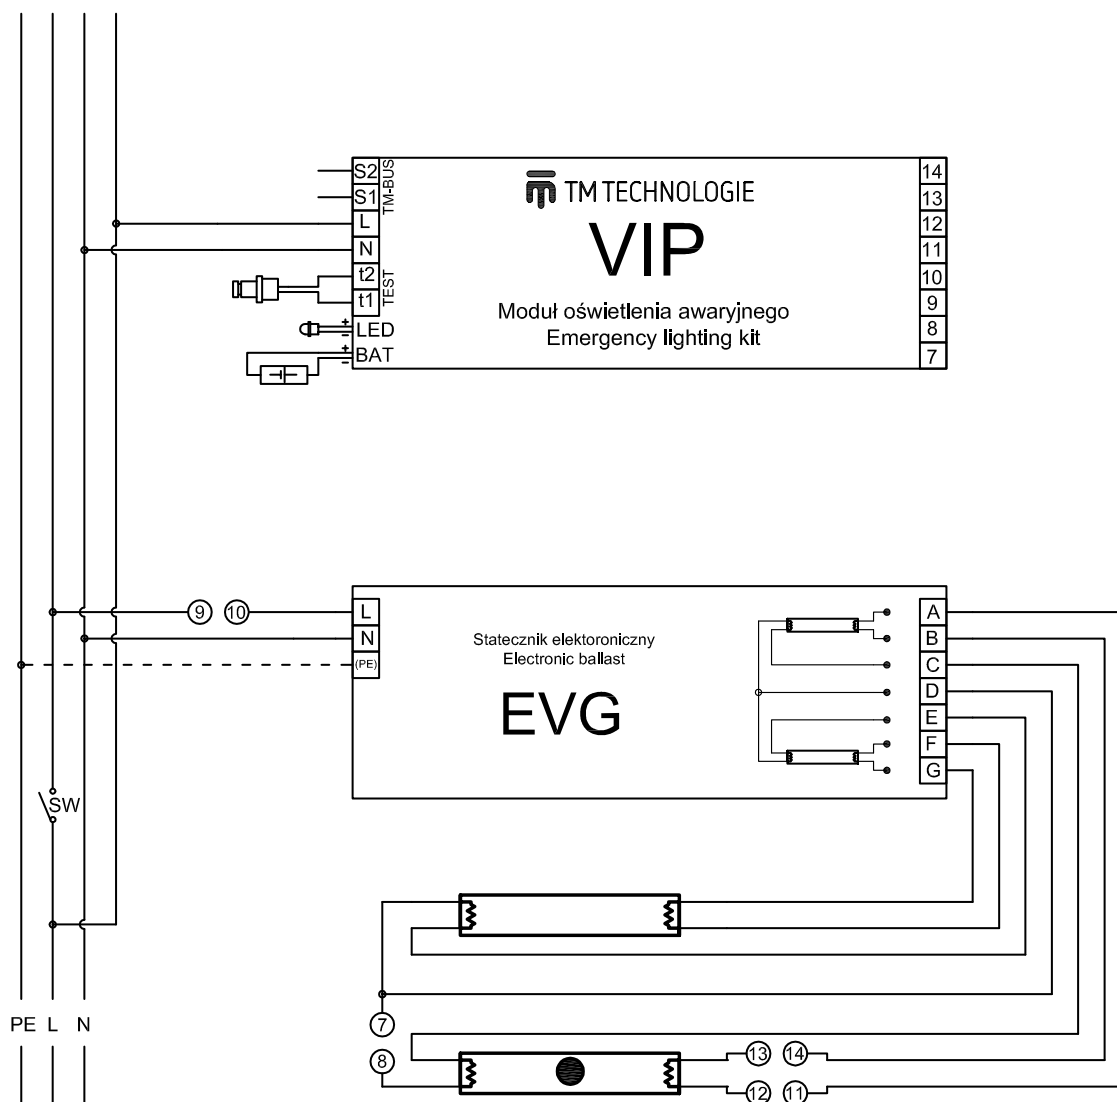

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	012	TM TECHNOLOGIE
Wersja	01/2014	

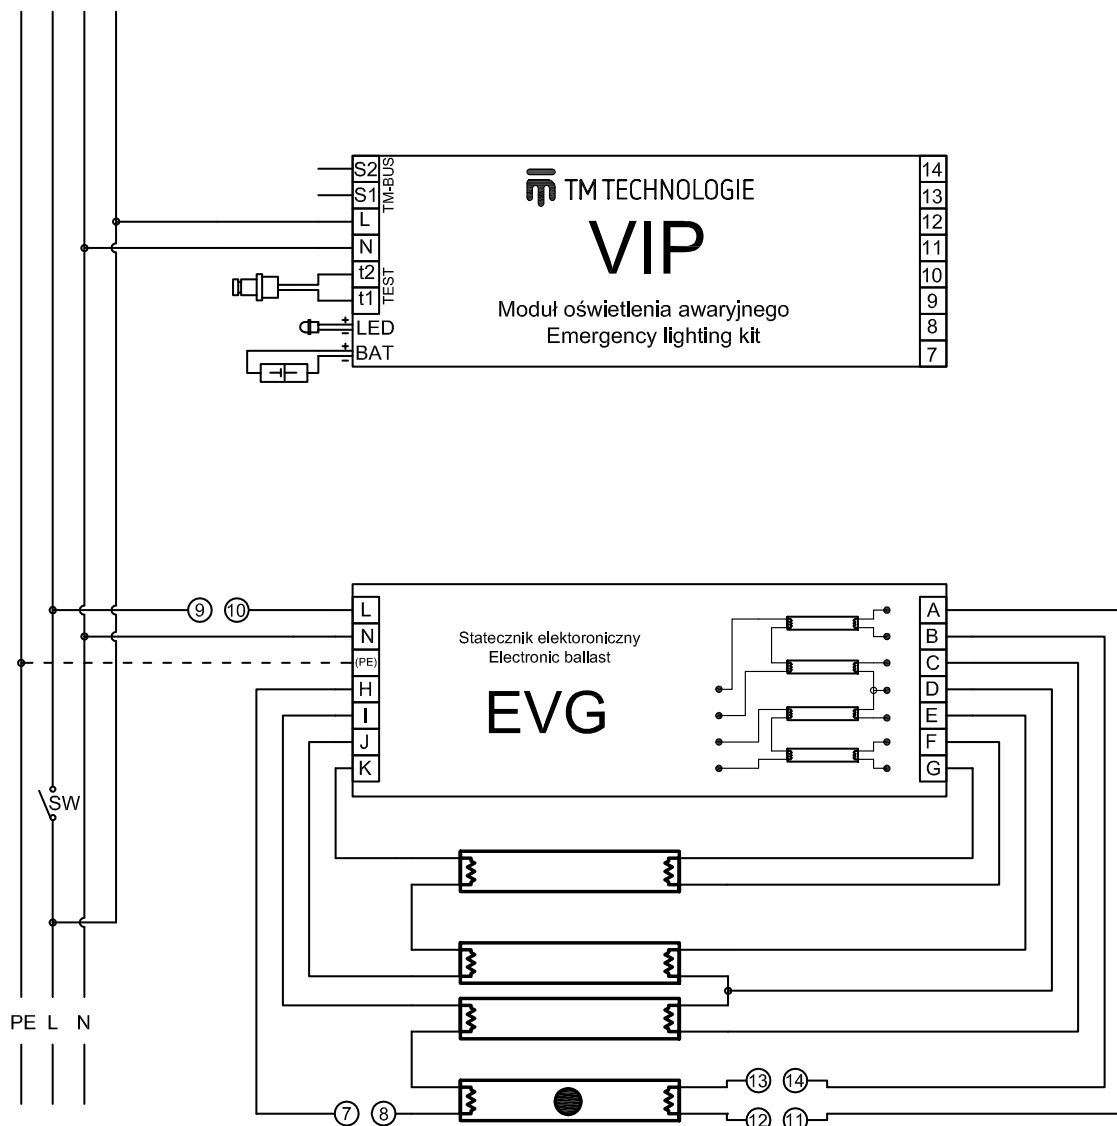

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	013	TM TECHNOLOGIE
Wersja	01/2014	

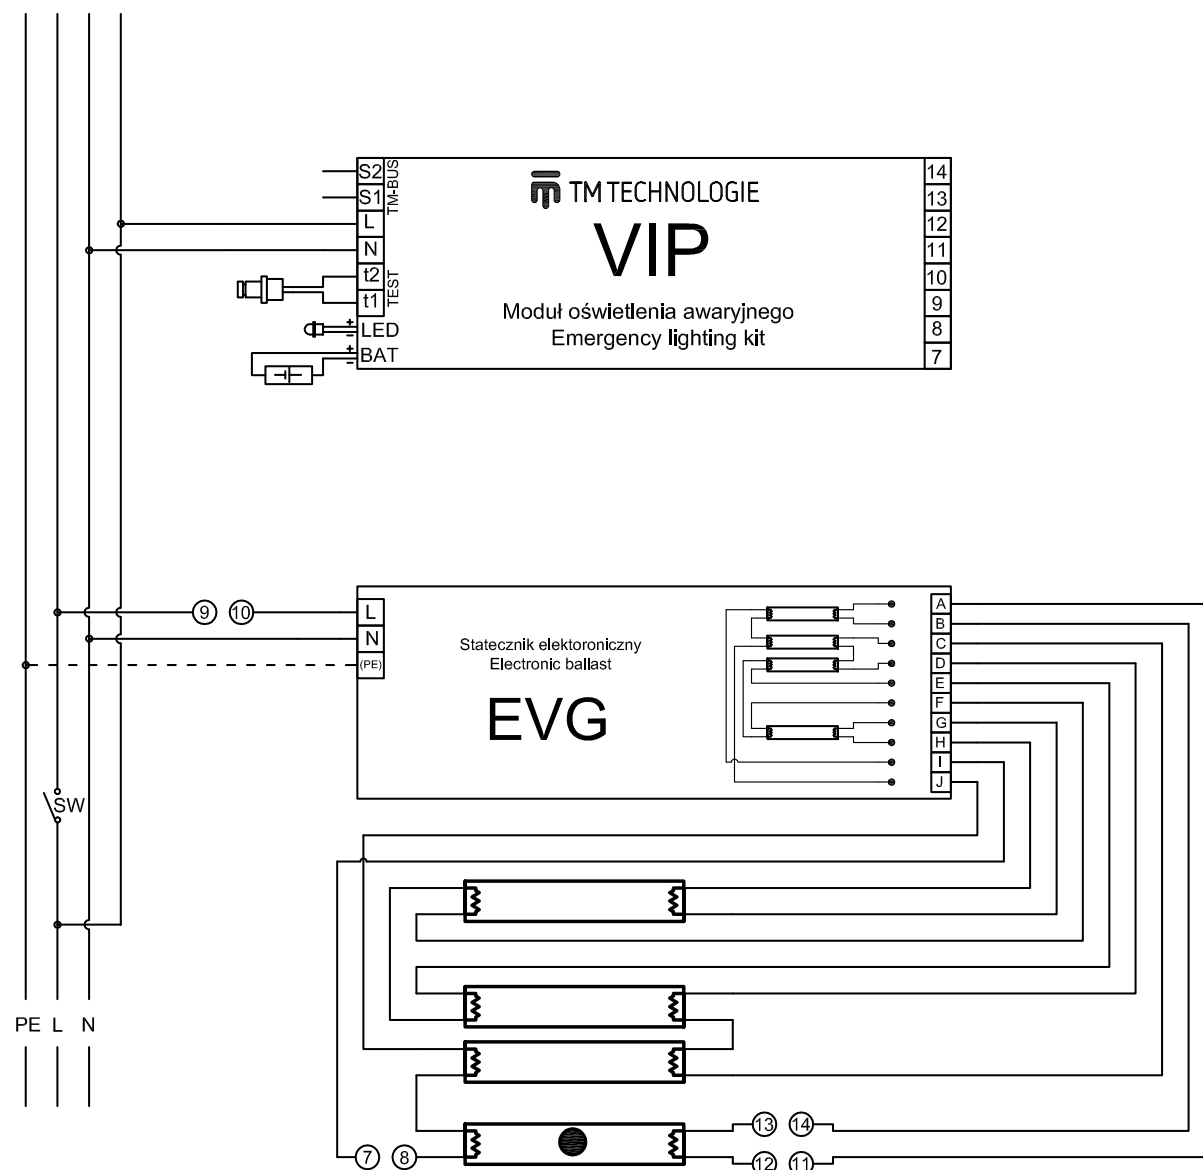

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	014	TM TECHNOLOGIE
Wersja	01/2014	

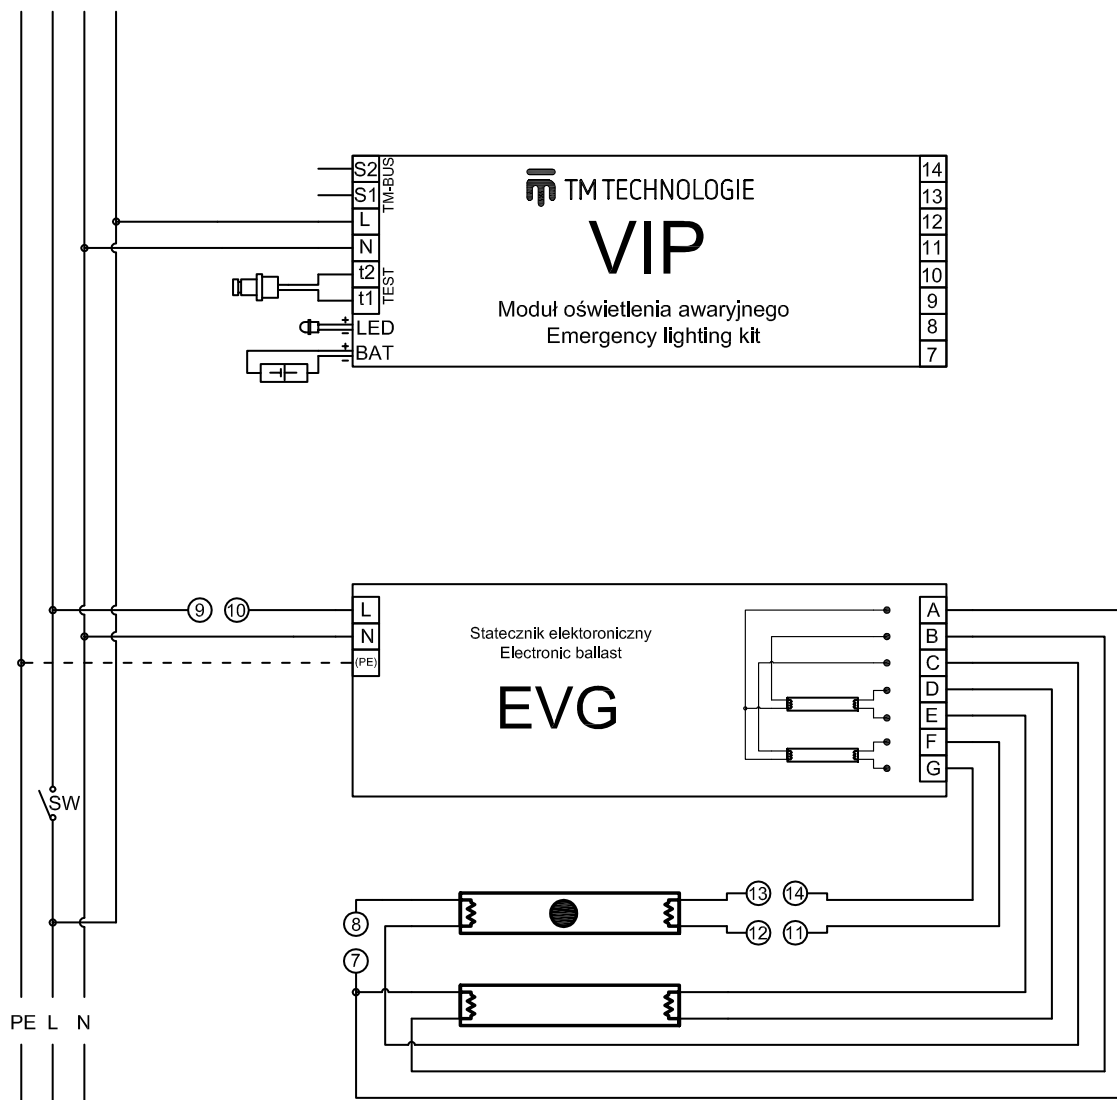

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓


Legenda:
PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
● - świetlówka działająca w trybie sieciowo-awaryjnym,
t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!
Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:
PE - depending on EVG model optional connection of protective lead,
● - fluorescent lamp working in maintained mode,
t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!
The above connection scheme might be incompatible for some types of electronic ballasts.
During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
All connection leads should be as short as possible.
Please read the manual of VIP emergency lighting kit carefully before use.
Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	015	TM TECHNOLOGIE
Wersja	01/2014	

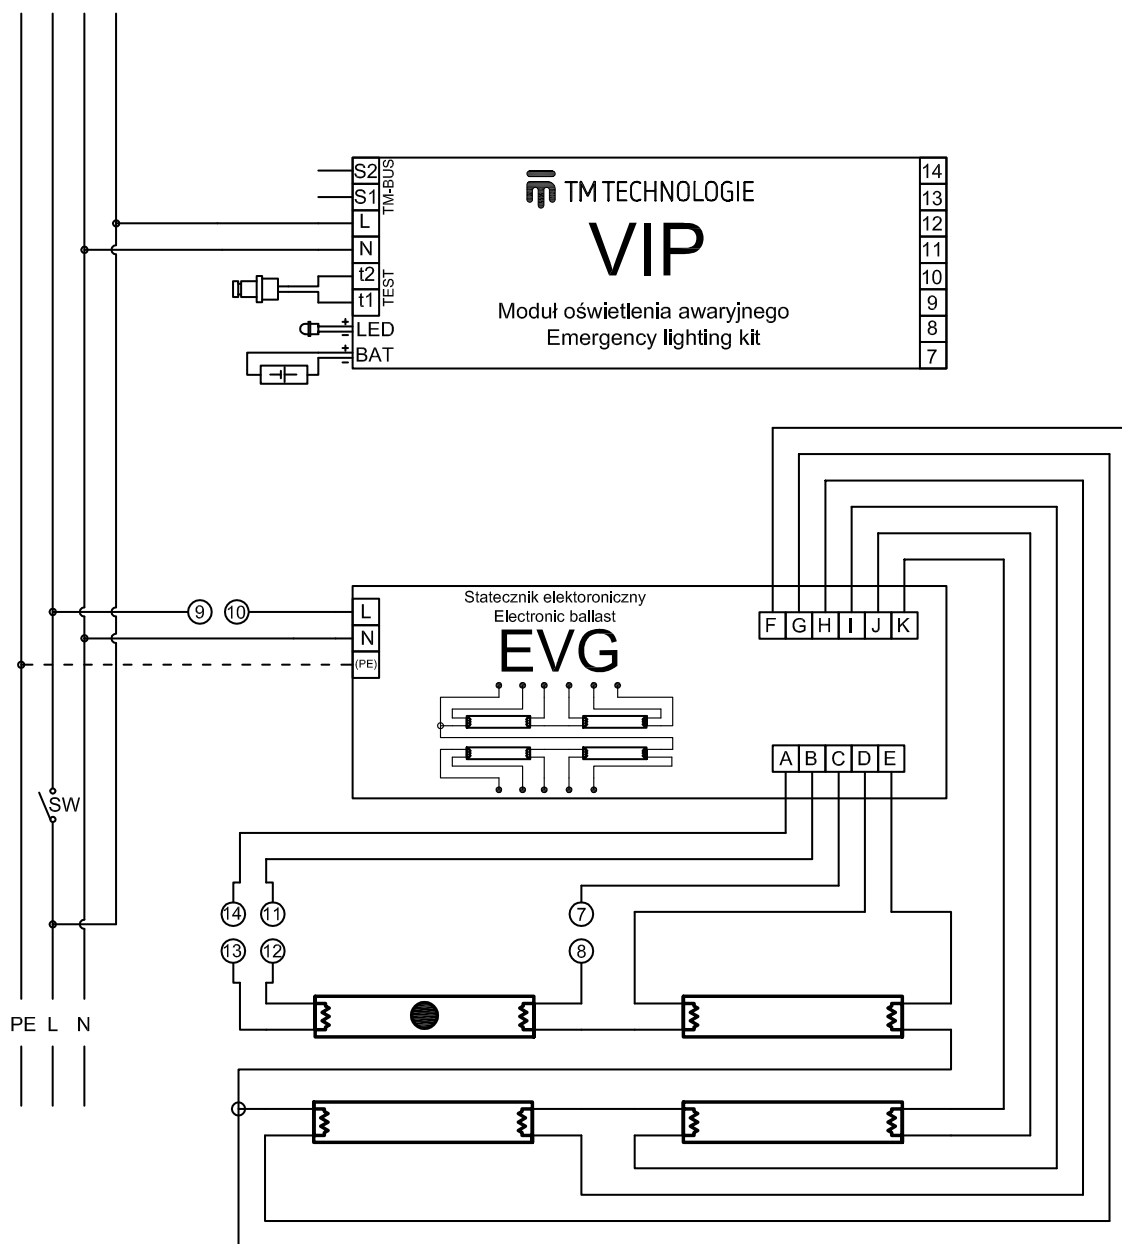

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST 2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	016	TM TECHNOLOGIE
Wersja	01/2014	

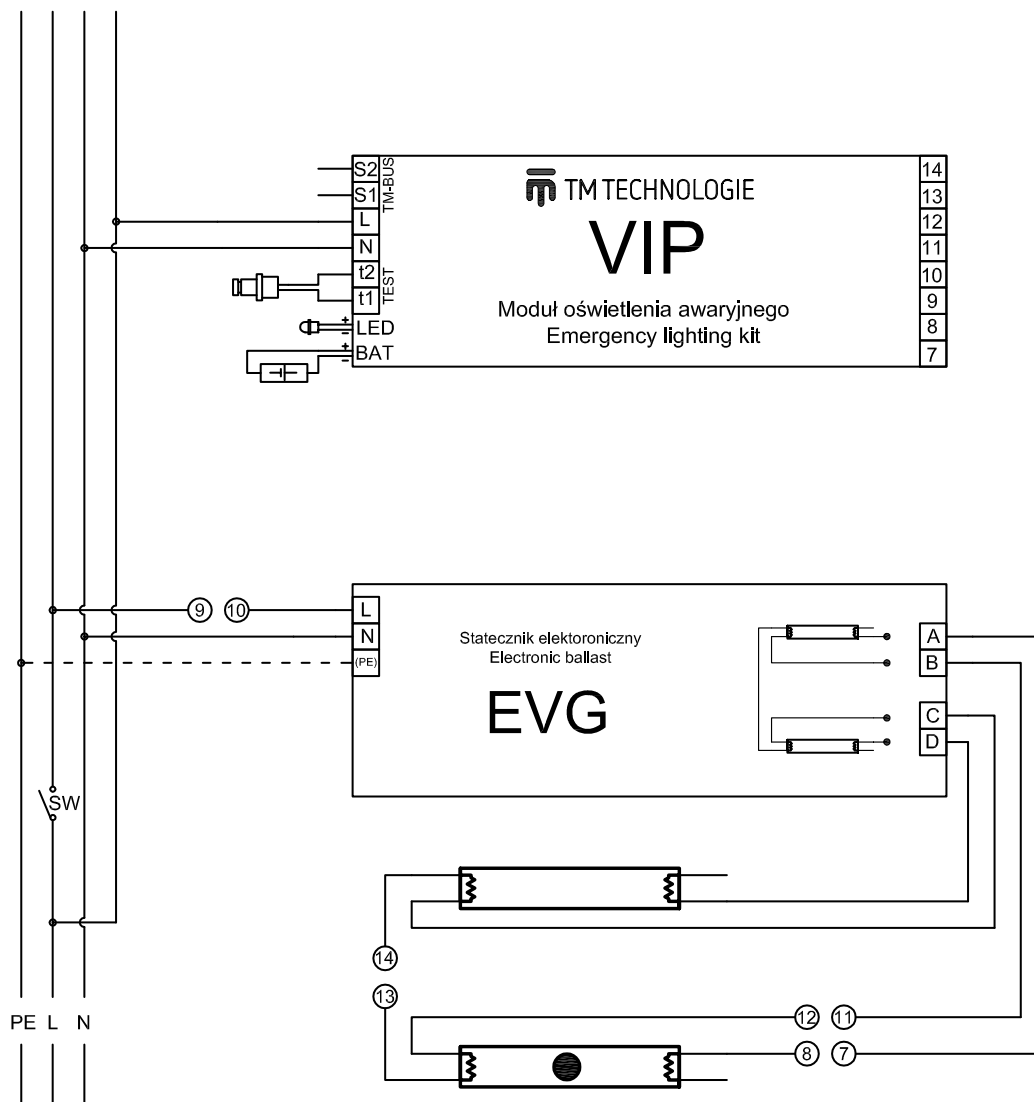

Schemat podłączenia modułów oświetlenia awaryjnego typu: Connection schema of emergency lighting kits :

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
● - świetlówka działająca w trybie sieciowo-awaryjnym,
t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
W razie pytań prosimy o kontakt pod nr +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
● - fluorescent lamp working in maintained mode,
t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
All connection leads should be as short as possible.
Please read the manual of VIP emergency lighting kit carefully before use.
Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	017	TM TECHNOLOGIE
Wersja	01/2014	

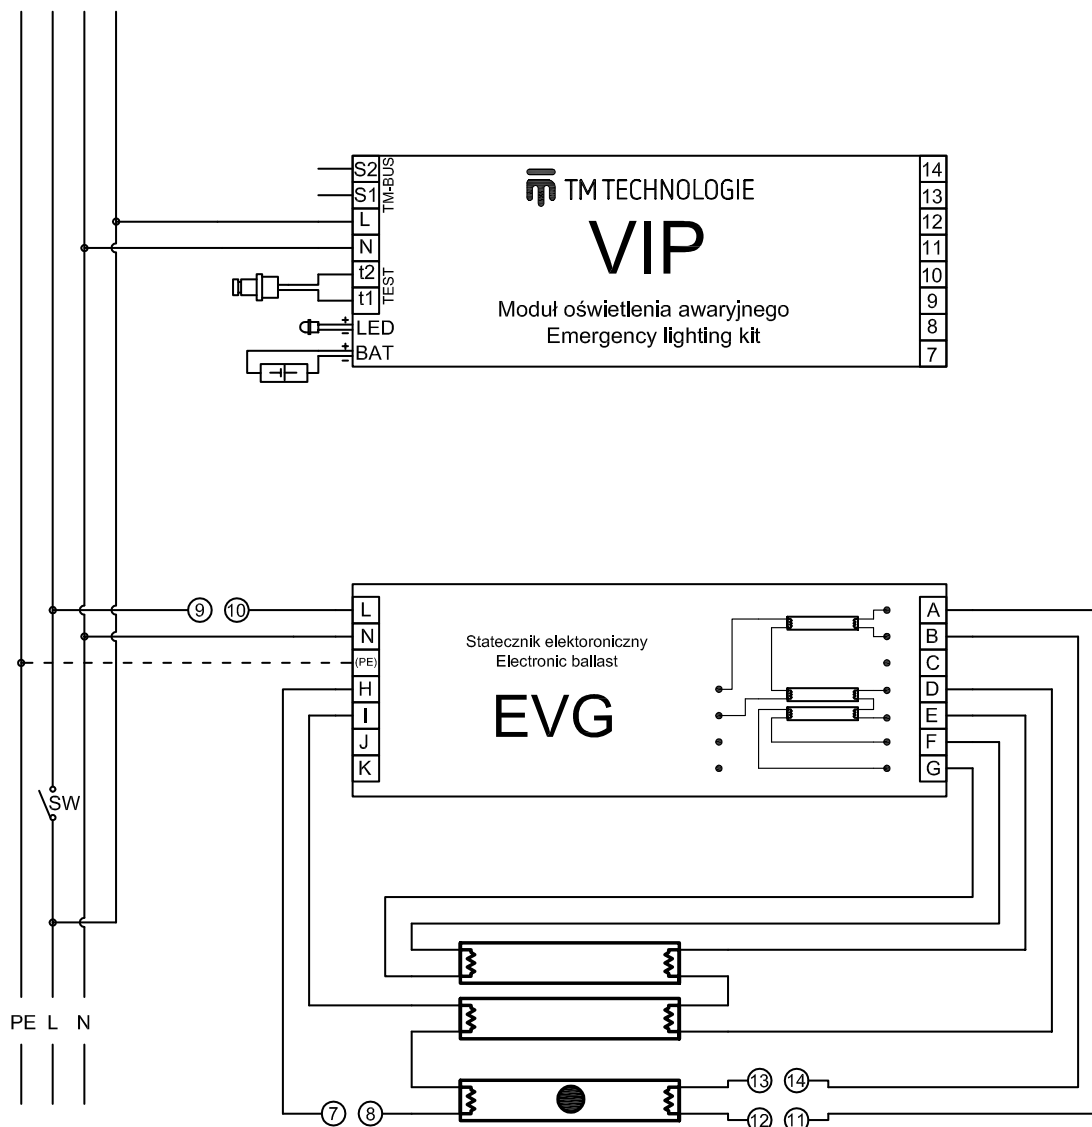

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60


NR. Schem.	018	TM TECHNOLOGIE
Wersja	01/2014	

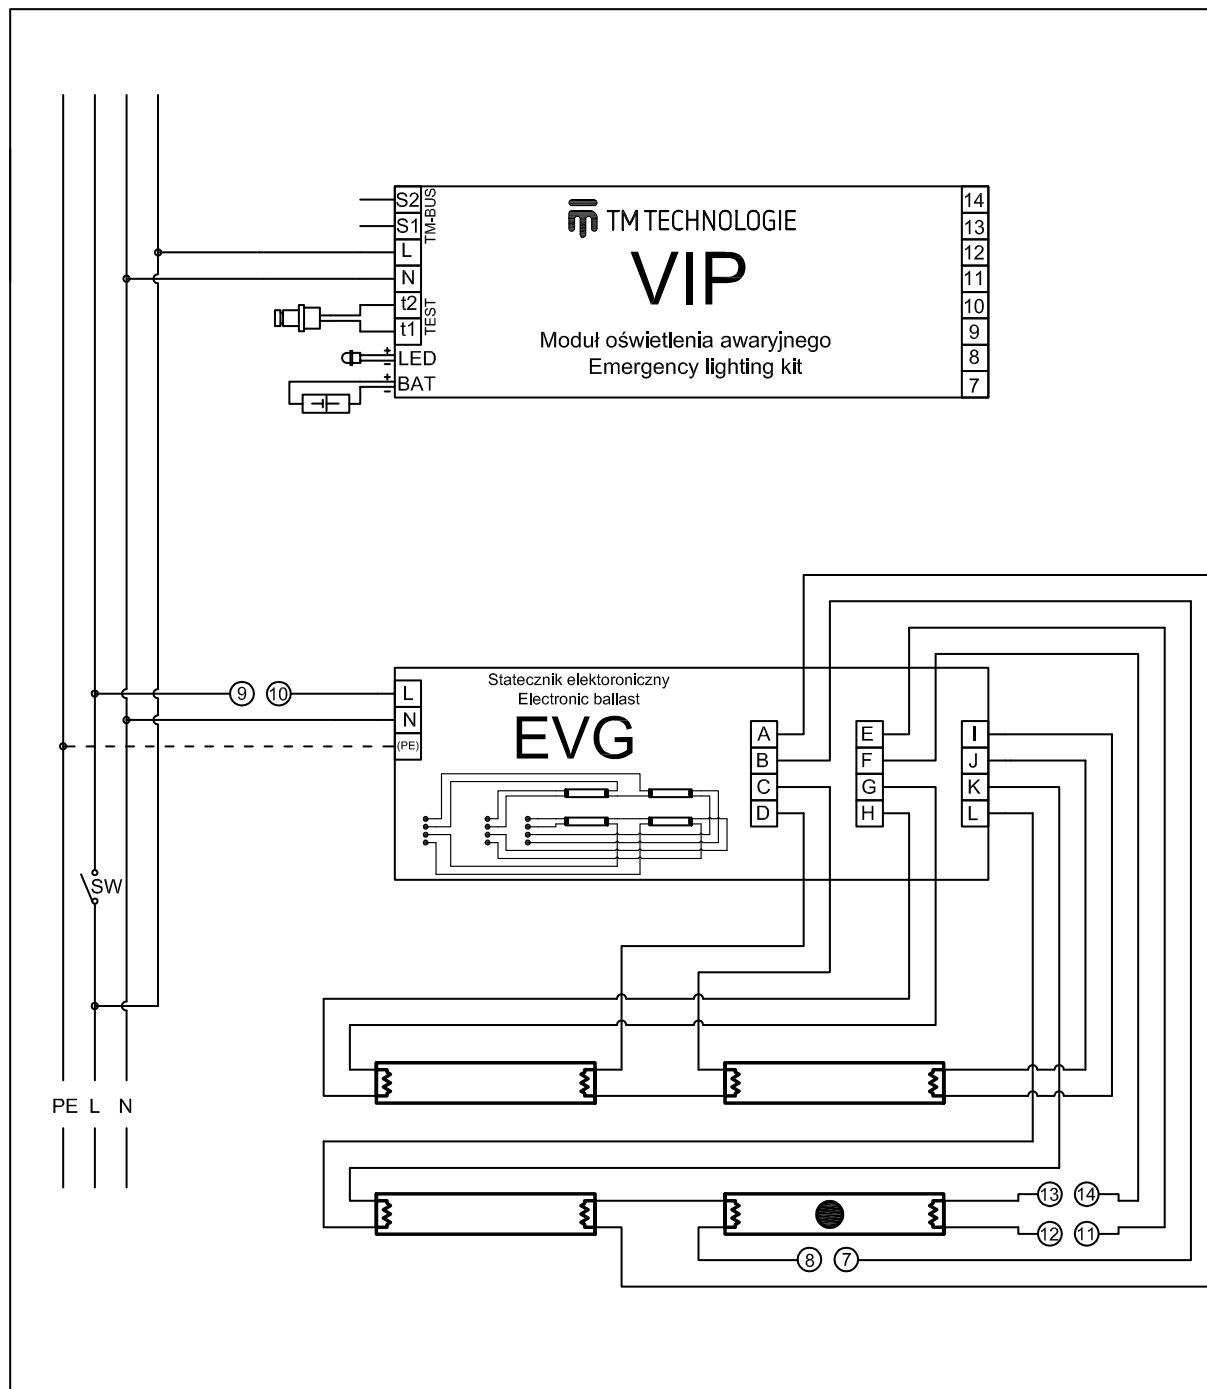

Schemat podłączenia modułów oświetlenia awaryjnego typu: Connection schema of emergency lighting kits :		
VIP ST		
VIP ST2		✓
VIP ST i(e)		✓
VIP PRO i		✓
VIP PRO i AT		✓
VIP PRO i DATA		✓

Legenda:		
PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,		
● - świetlówka działająca w trybie sieciowo-awaryjnym,		
t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),		
S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),		
⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.		
Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",		
Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".		
Uwaga!		
Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.		
Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.		
Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.		
Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.		
Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.		
W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60		
Legend:		
PE - depending on EVG model optional connection of protective lead,		
● - fluorescent lamp working in maintained mode,		
t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)		
S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),		
⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.		
LED diode lead -length 90 or 30 cm. Black "+", black and red "-".		
Accumulator's lead -length 30 cm. Red "+", black "-"		
Attention!		
The above connection scheme might be incompatible for some types of electronic ballasts.		
During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.		
All connection leads should be as short as possible.		
Please read the manual of VIP emergency lighting kit carefully before use.		
Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60		

NR. Schem.	019	TM TECHNOLOGIE
Wersja	01/2014	

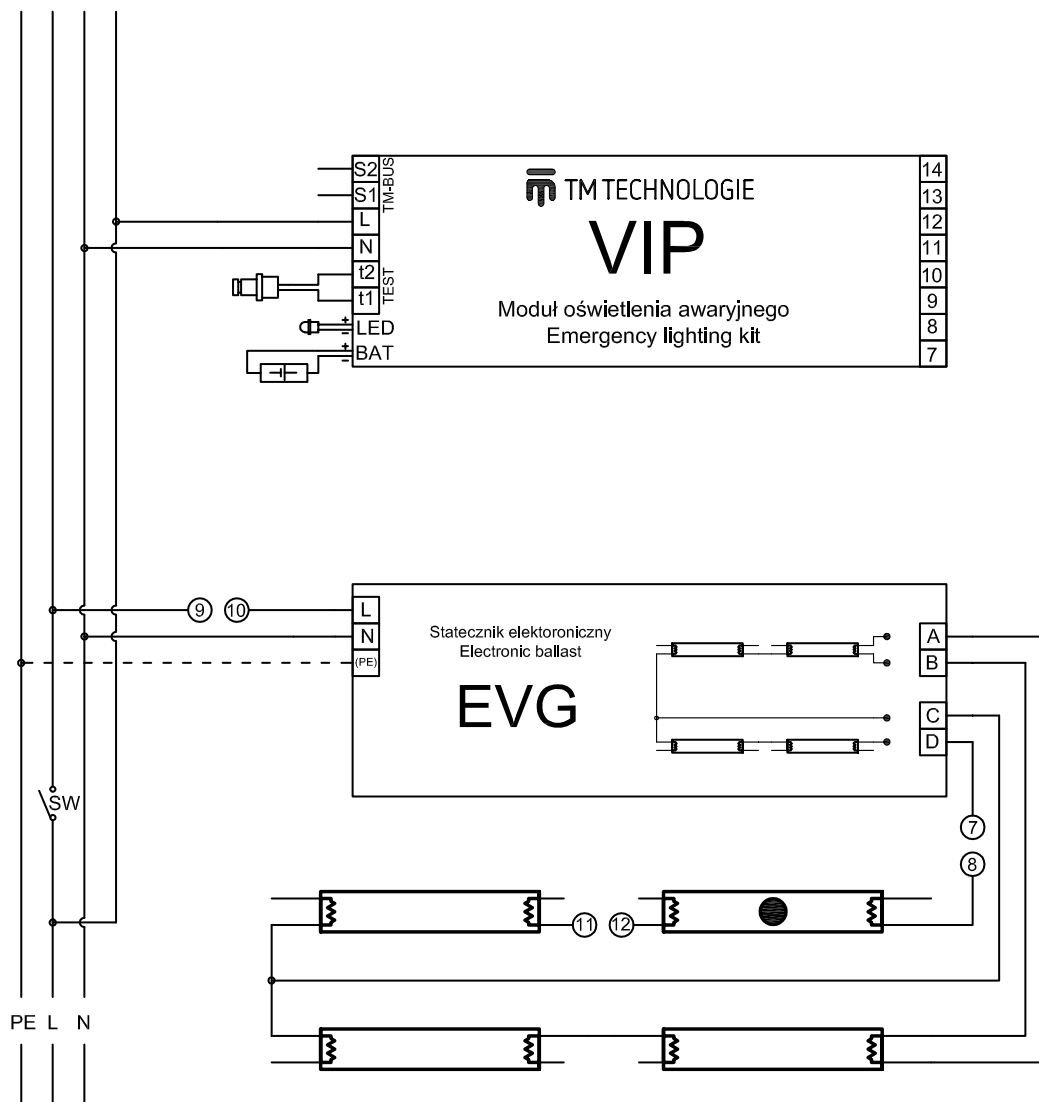

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	020	TM TECHNOLOGIE
Wersja	01/2014	

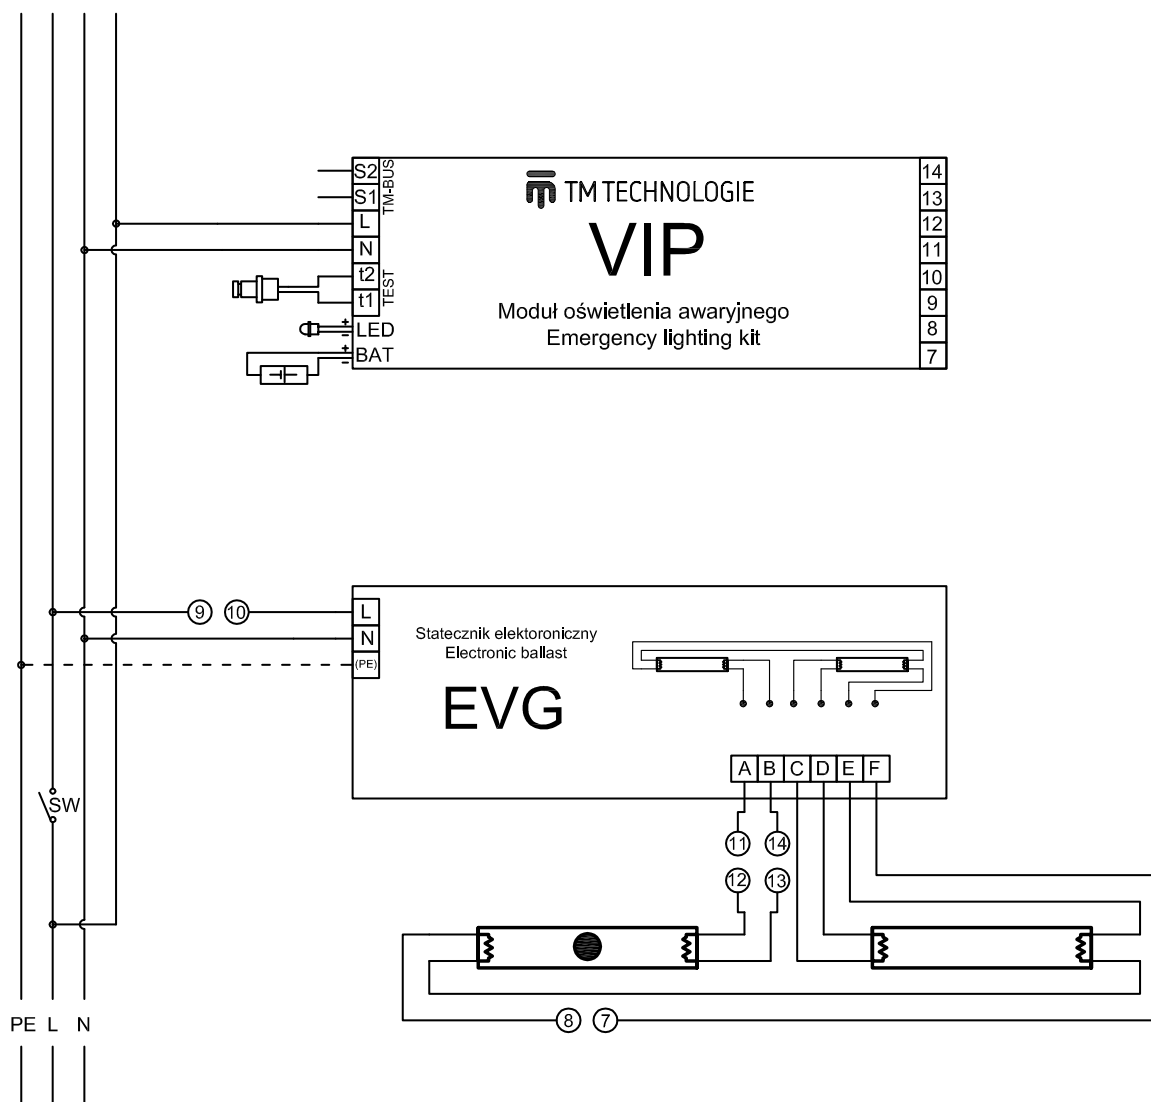

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 (8) - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 (8) - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	021	TM TECHNOLOGIE
Wersja	01/2014	

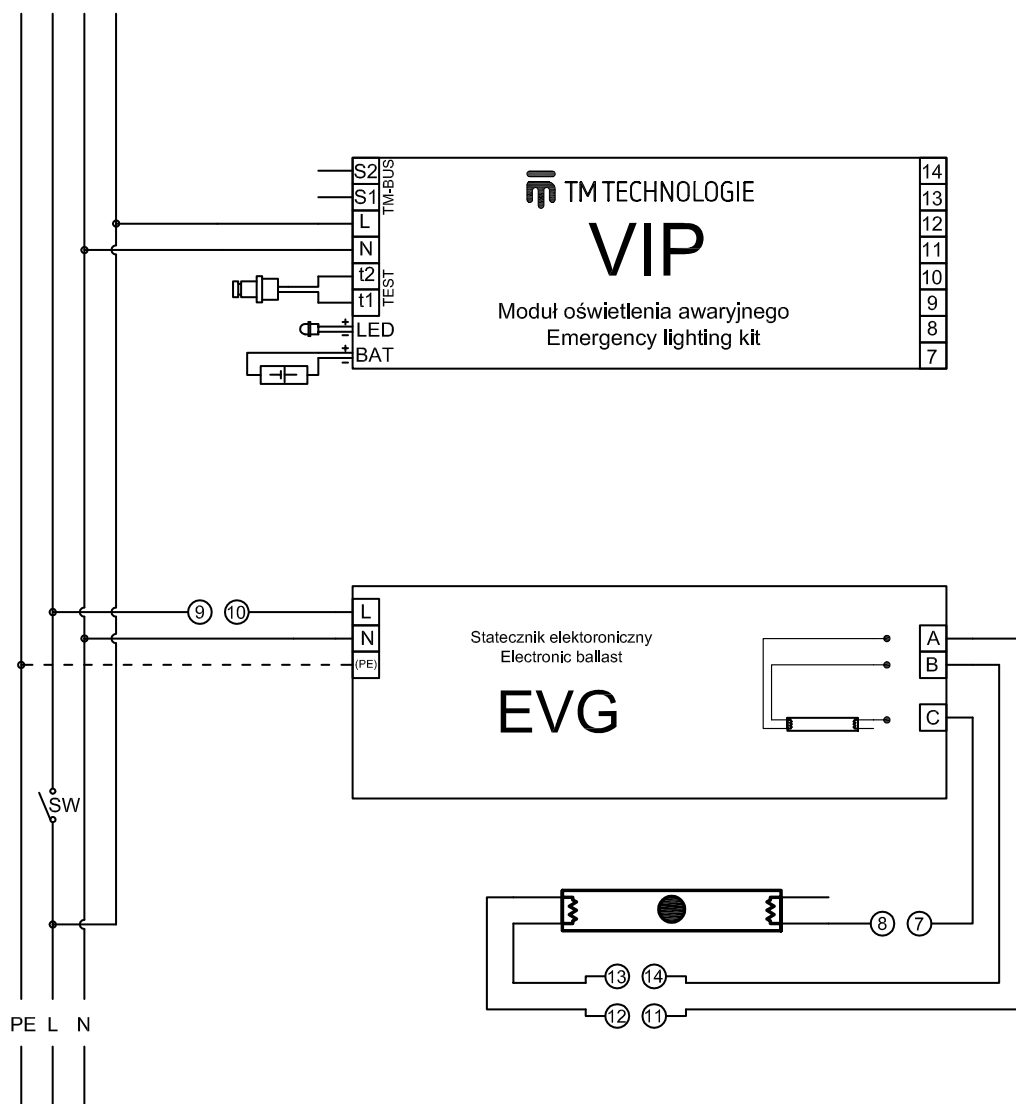

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	022	TM TECHNOLOGIE
Wersja	01/2014	

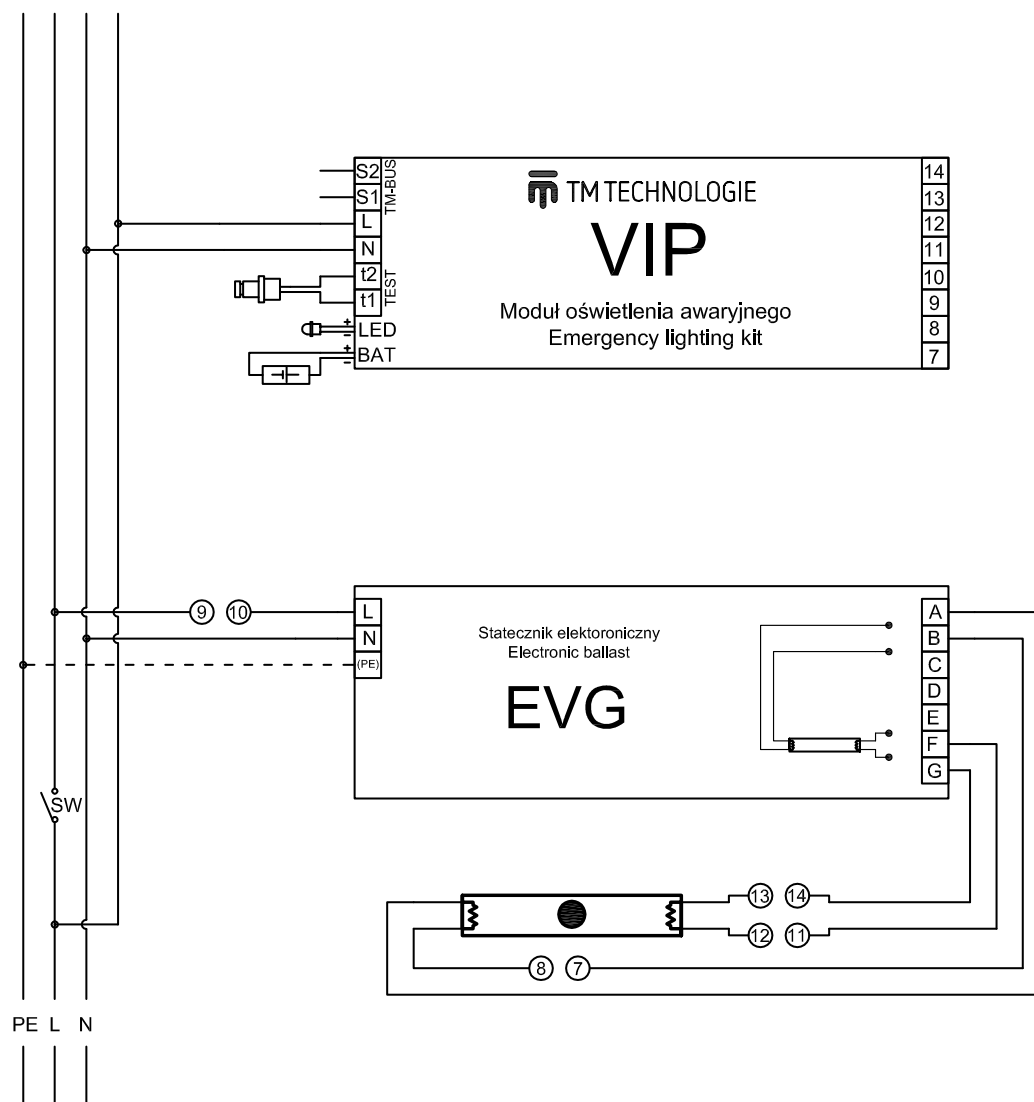

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 Ⓢ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 Ⓢ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	023	TM TECHNOLOGIE
Wersja	01/2014	

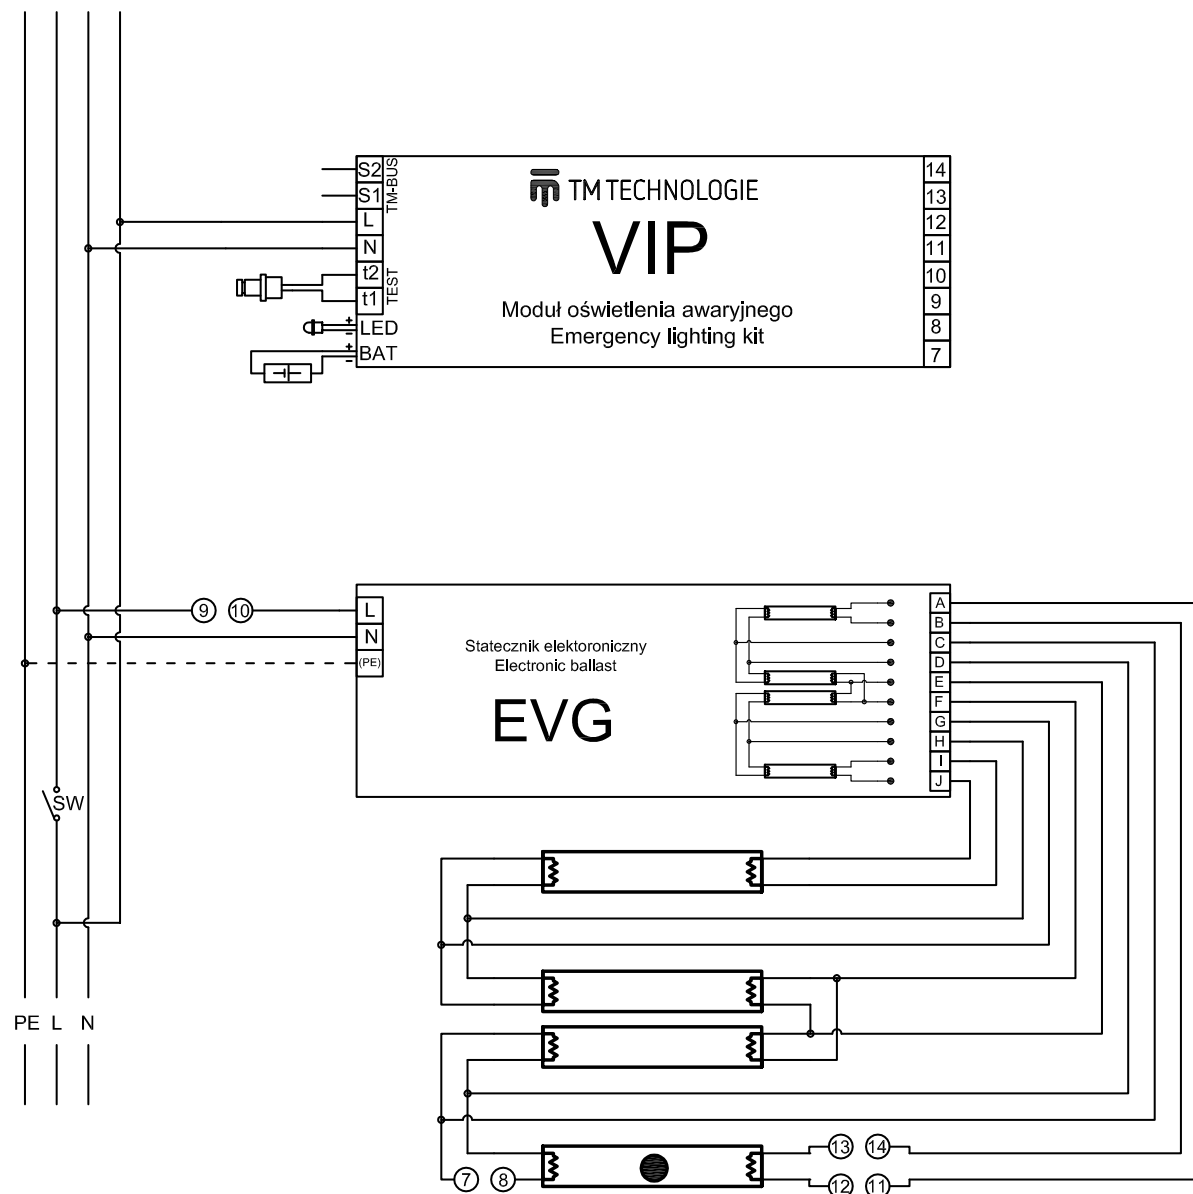

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	024	TM TECHNOLOGIE
Wersja	01/2014	

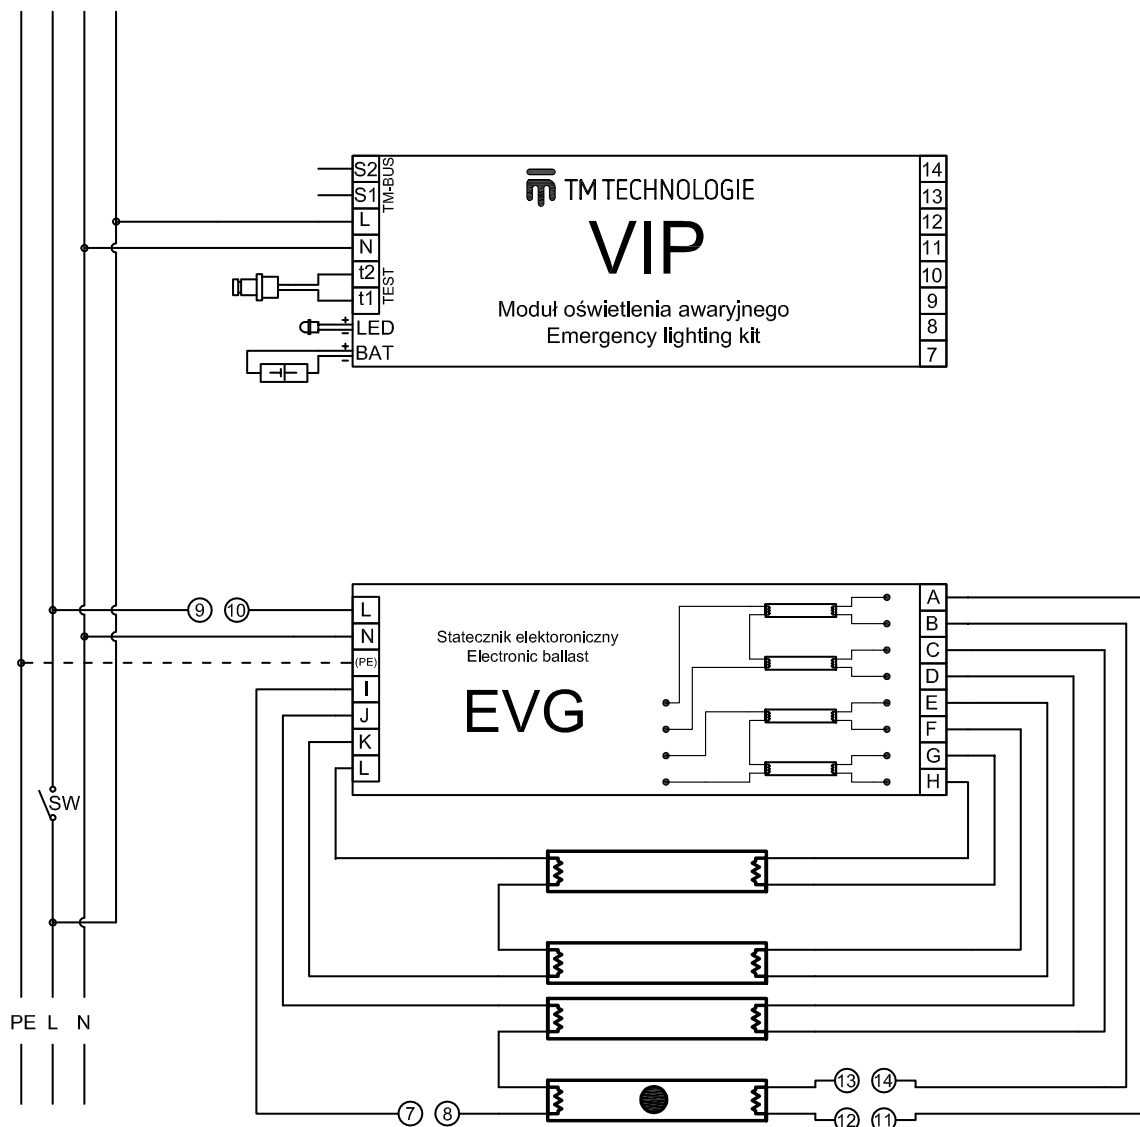

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"


Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	025	TM TECHNOLOGIE
Wersja	01/2014	

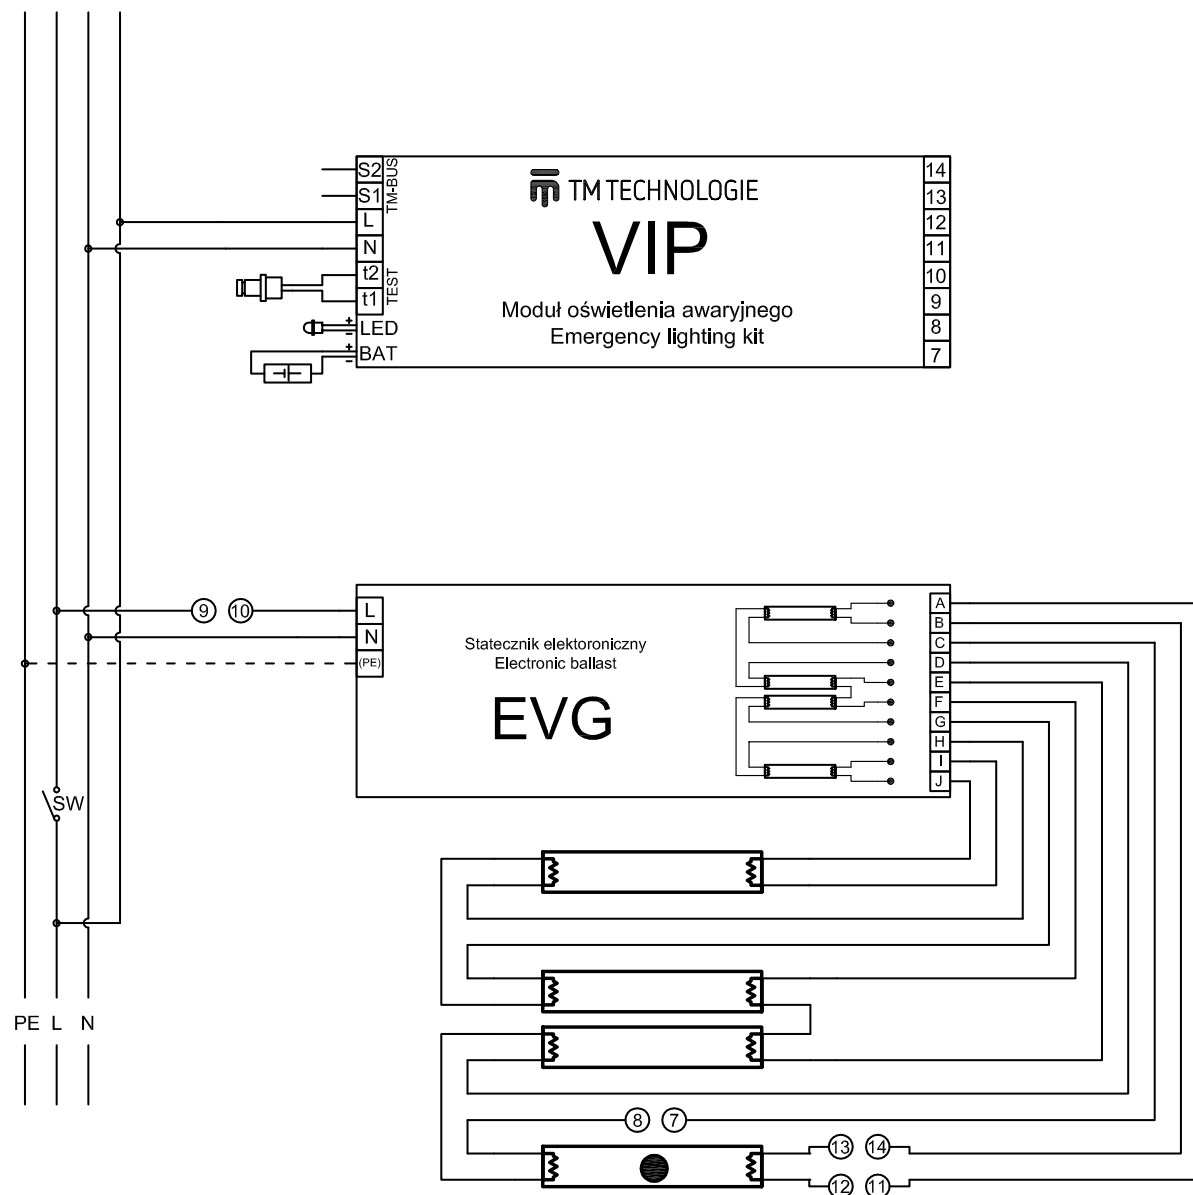

Schemat podłączenia modułów oświetlenia awaryjnego typu: Connection schema of emergency lighting kits :		
VIP ST		
VIP ST2		✓
VIP ST i(e)		✓
VIP PRO i		✓
VIP PRO i AT		✓
VIP PRO i DATA		✓
Legenda: PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego, ● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA), S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA), ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód. Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-". Uwaga! Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych. Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych. Wszystkie przewody przyłączeniowe powinny być jak najkrótsze. Przed przystąpieniem do prac zapoznaj się z instrukcją użytkowania modułu oświetlenia awaryjnego VIP. Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60		
Legend: PE - depending on EVG model optional connection of protective lead, ● - fluorescent lamp working in maintained mode, t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits) S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits), ⑧ - place of lead disconnexion in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected. LED diode lead -length 90 or 30 cm. Black "+", black and red "-". Accumulator's lead - length 30 cm. Red "+", black "-"		
Attention! The above connection scheme might be incompatible for some types of electronic ballasts. During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey. All connection leads should be as short as possible. Please read the manual of VIP emergency lighting kit carefully before use. Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60		
NR. Schem.	026	
Wersja	01/2014	

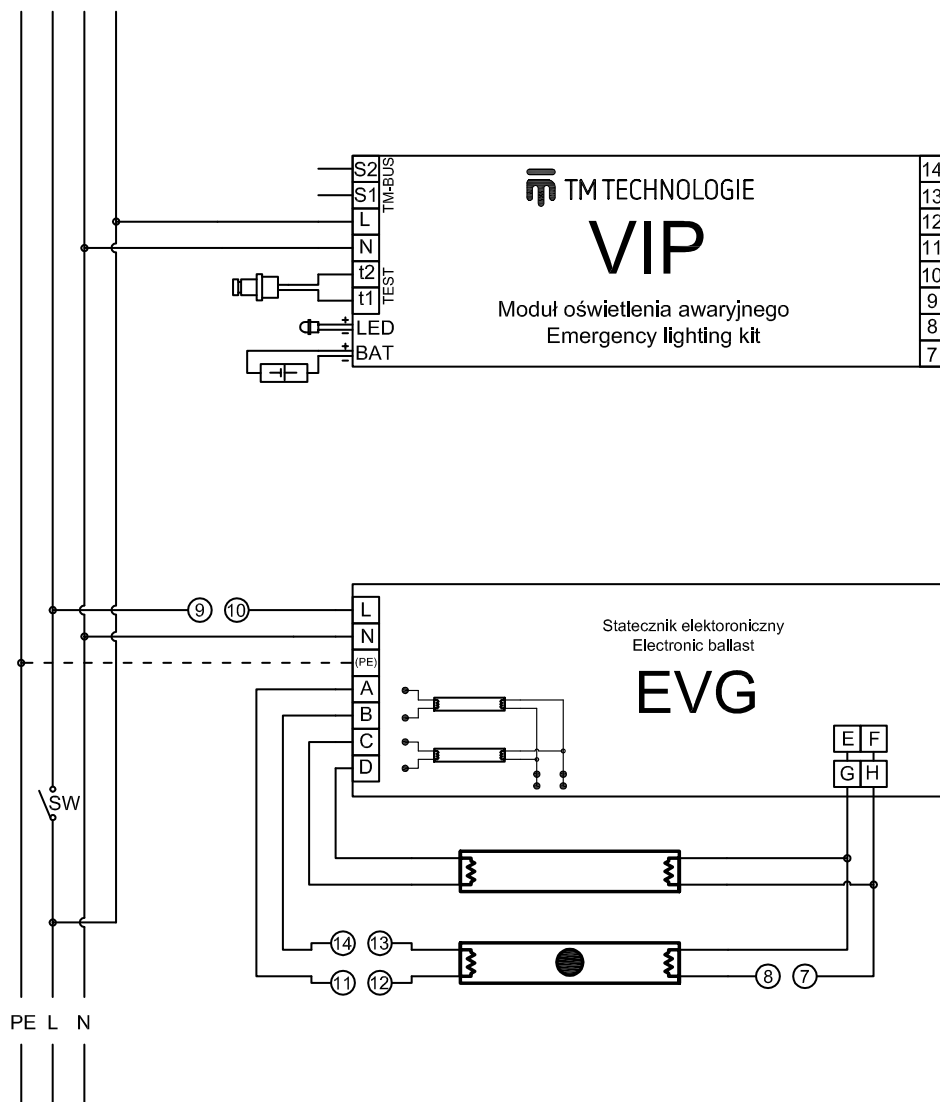

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	027	TM TECHNOLOGIE
Wersja	01/2014	

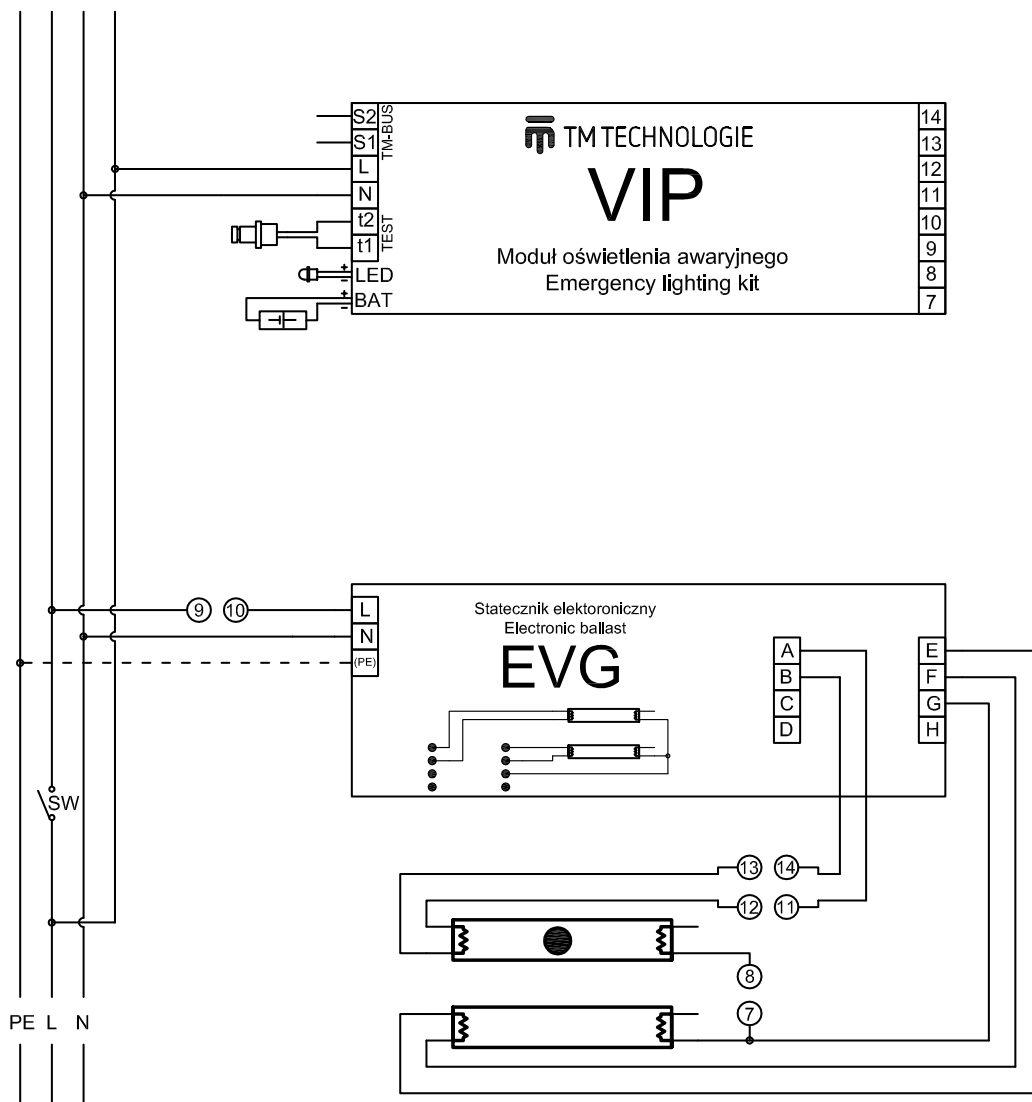

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓


Legenda:
PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
● - świetlówka działająca w trybie sieciowo-awaryjnym,
t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!
Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:
PE - depending on EVG model optional connection of protective lead,
● - fluorescent lamp working in maintained mode,
t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!
The above connection scheme might be incompatible for some types of electronic ballasts.
During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
All connection leads should be as short as possible.
Please read the manual of VIP emergency lighting kit carefully before use.
Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	028	TM TECHNOLOGIE
Wersja	01/2014	

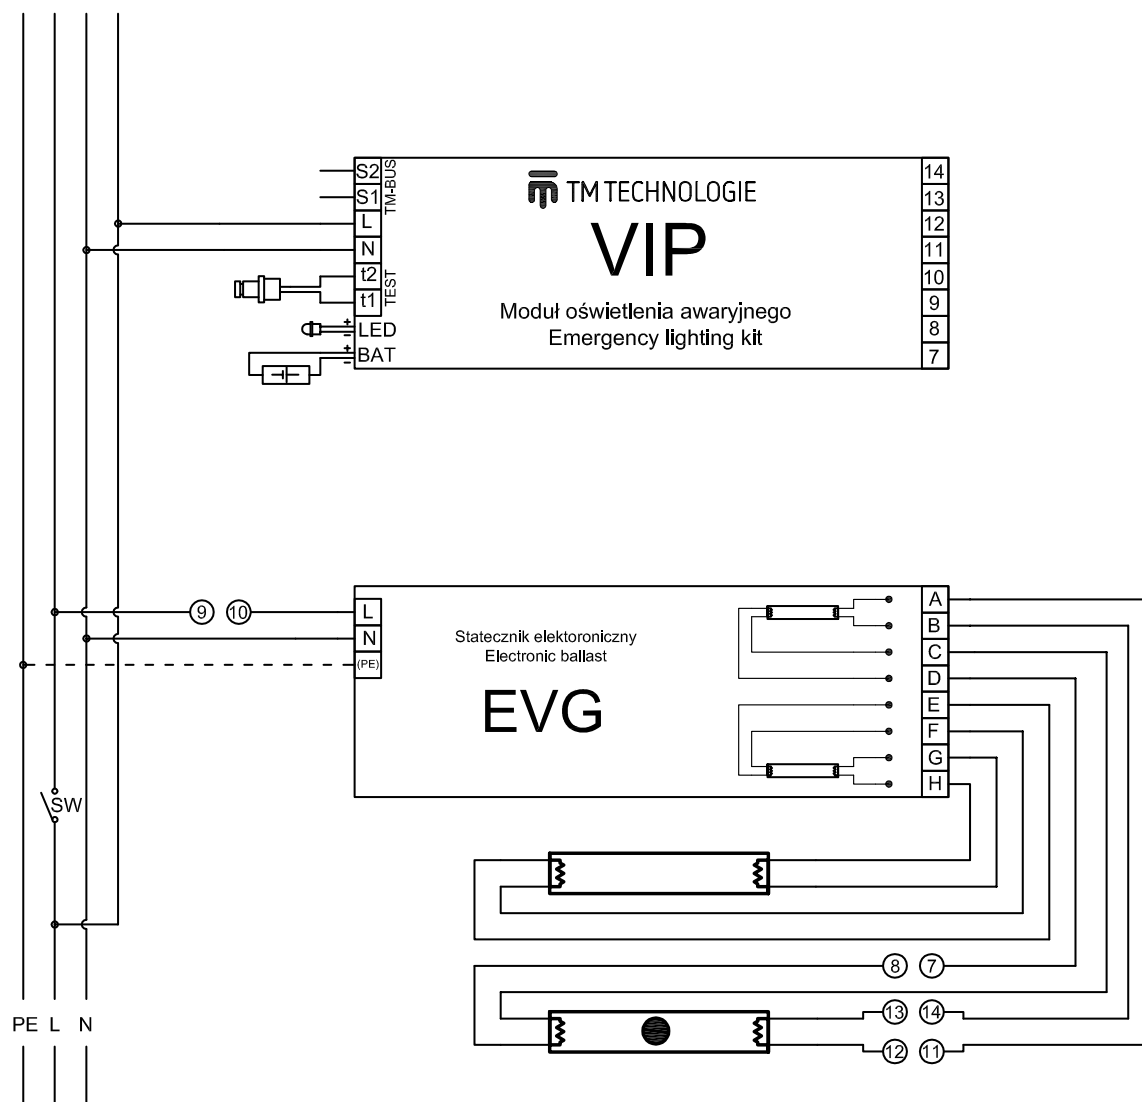

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,

● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),

S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),

⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.

Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.

Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.

Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.

Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,

● - fluorescent lamp working in maintained mode,

t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)

S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),

⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.

LED diode lead -length 90 or 30 cm. Black "+", black and red "-".

Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.

During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.

All connection leads should be as short as possible.

Please read the manual of VIP emergency lighting kit carefully before use. Please test carefully your circuit after instalation. More details tel:

+48 12 444 60 60 ext. 60


NR. Schem.

029

Wersja

01/2014

TM TECHNOLOGIE

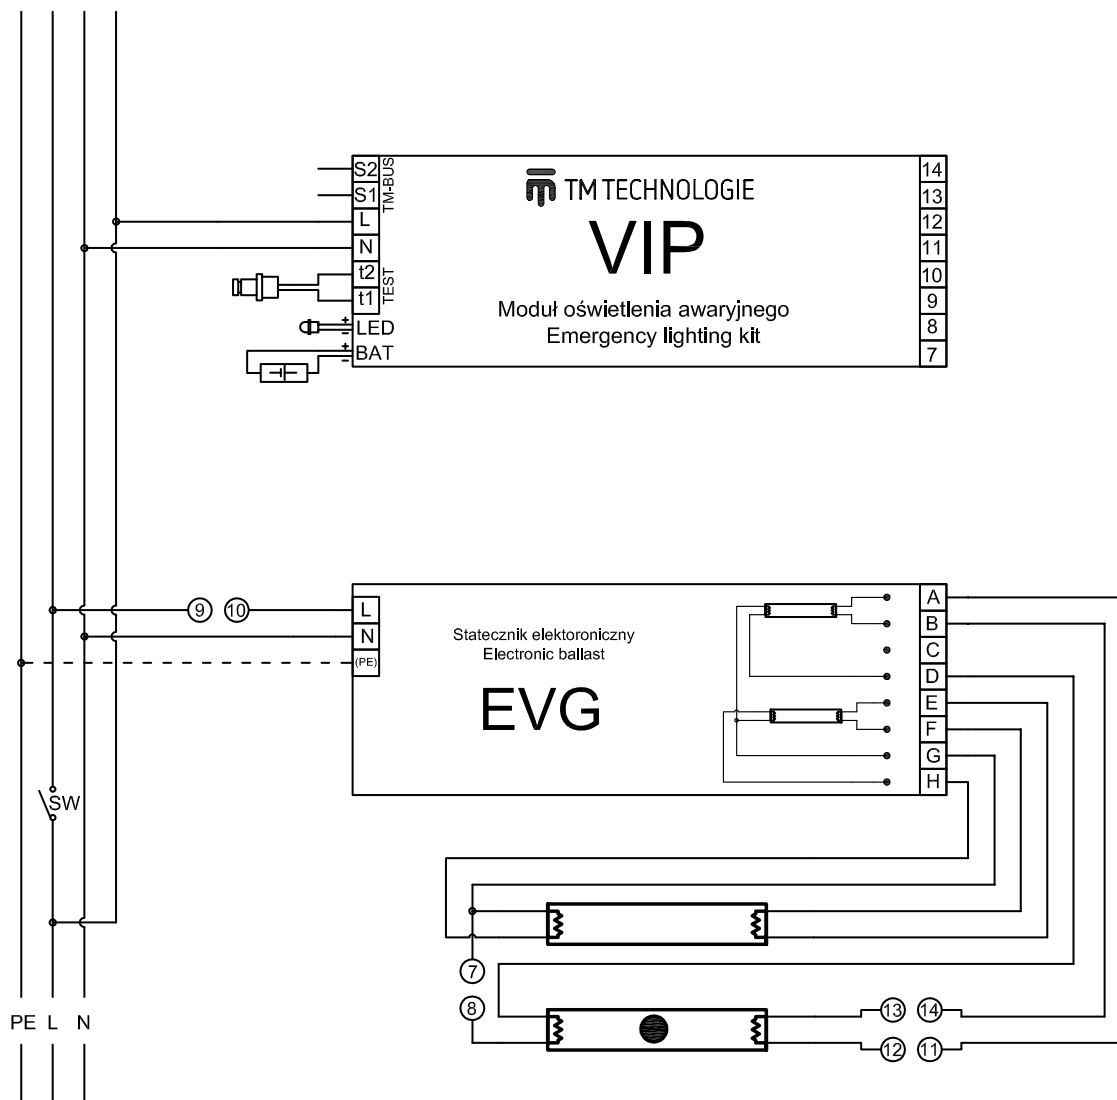

Schemat podłączenia modułów oświetlenia awaryjnego typu:
Connection schema of emergency lighting kits :

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓


Legenda:
 PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!
 Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:
 PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!
 The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	030	TM TECHNOLOGIE
Wersja	01/2014	

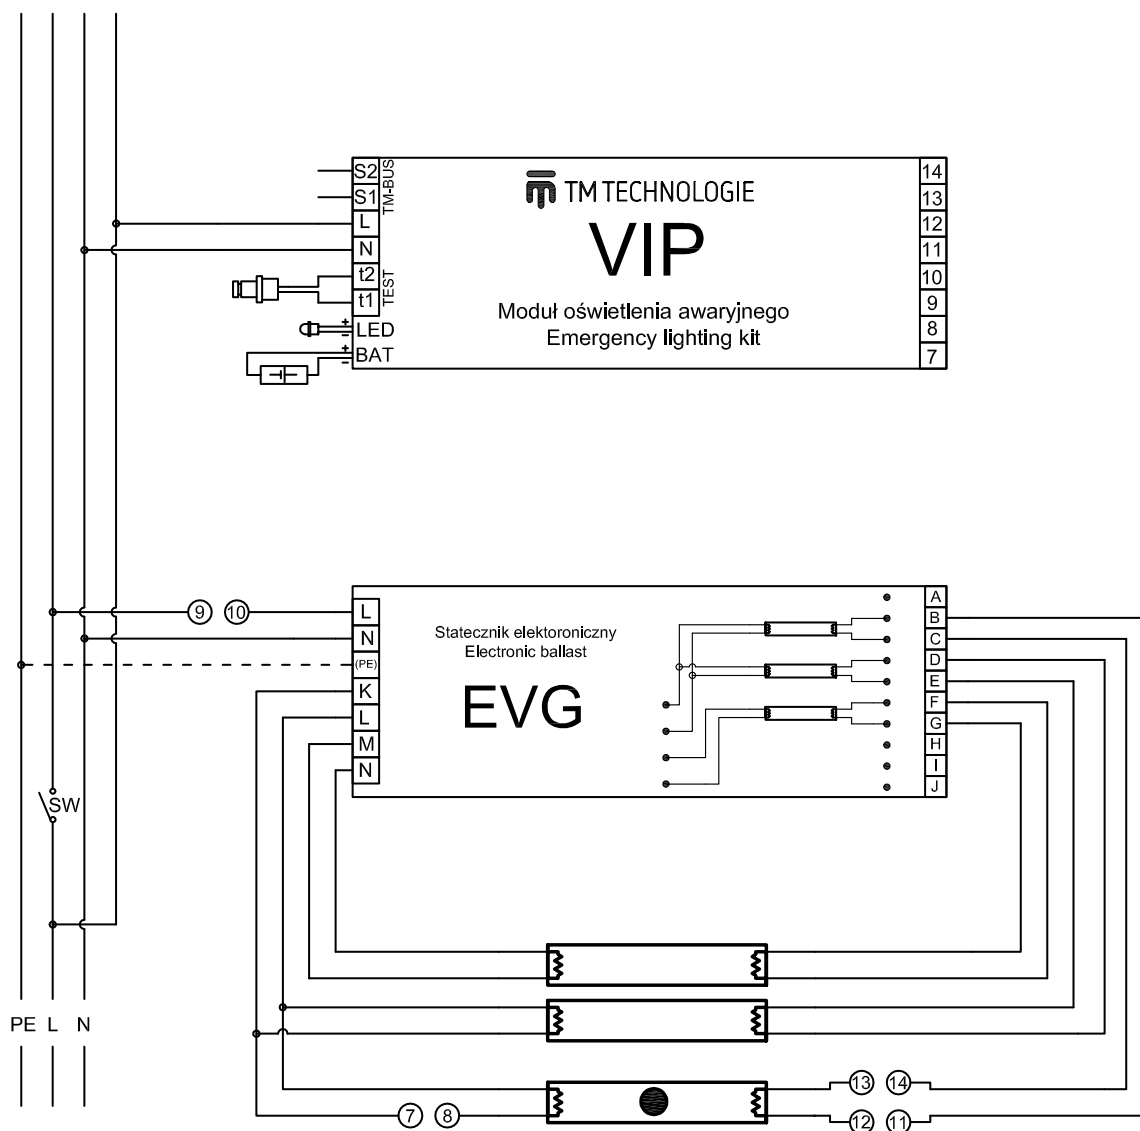

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1, t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1, S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1, t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1, S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	031	TM TECHNOLOGIE
Wersja	01/2014	

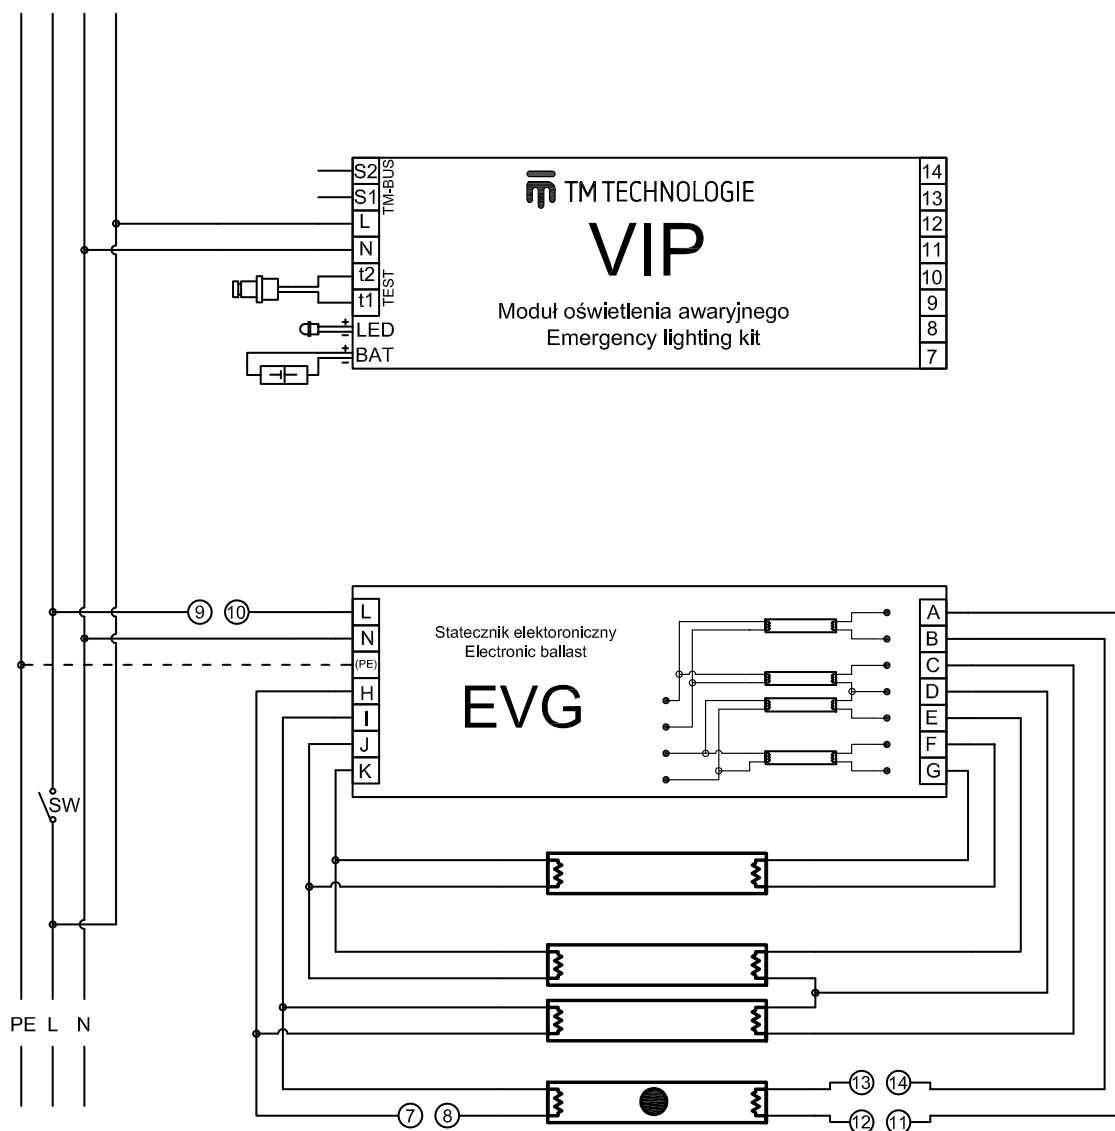

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,

● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),

S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),

⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.

Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.

Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.

Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.

Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,

● - fluorescent lamp working in maintained mode,

t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)

S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),

⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.

LED diode lead -length 90 or 30 cm. Black "+", black and red "-".

Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.

During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.

All connection leads should be as short as possible.

Please read the manual of VIP emergency lighting kit carefully before use. Please test carefully your circuit after instalation. More details tel:

+48 12 444 60 60 ext. 60


NR. Schem.

032

Wersja

01/2014

TM TECHNOLOGIE

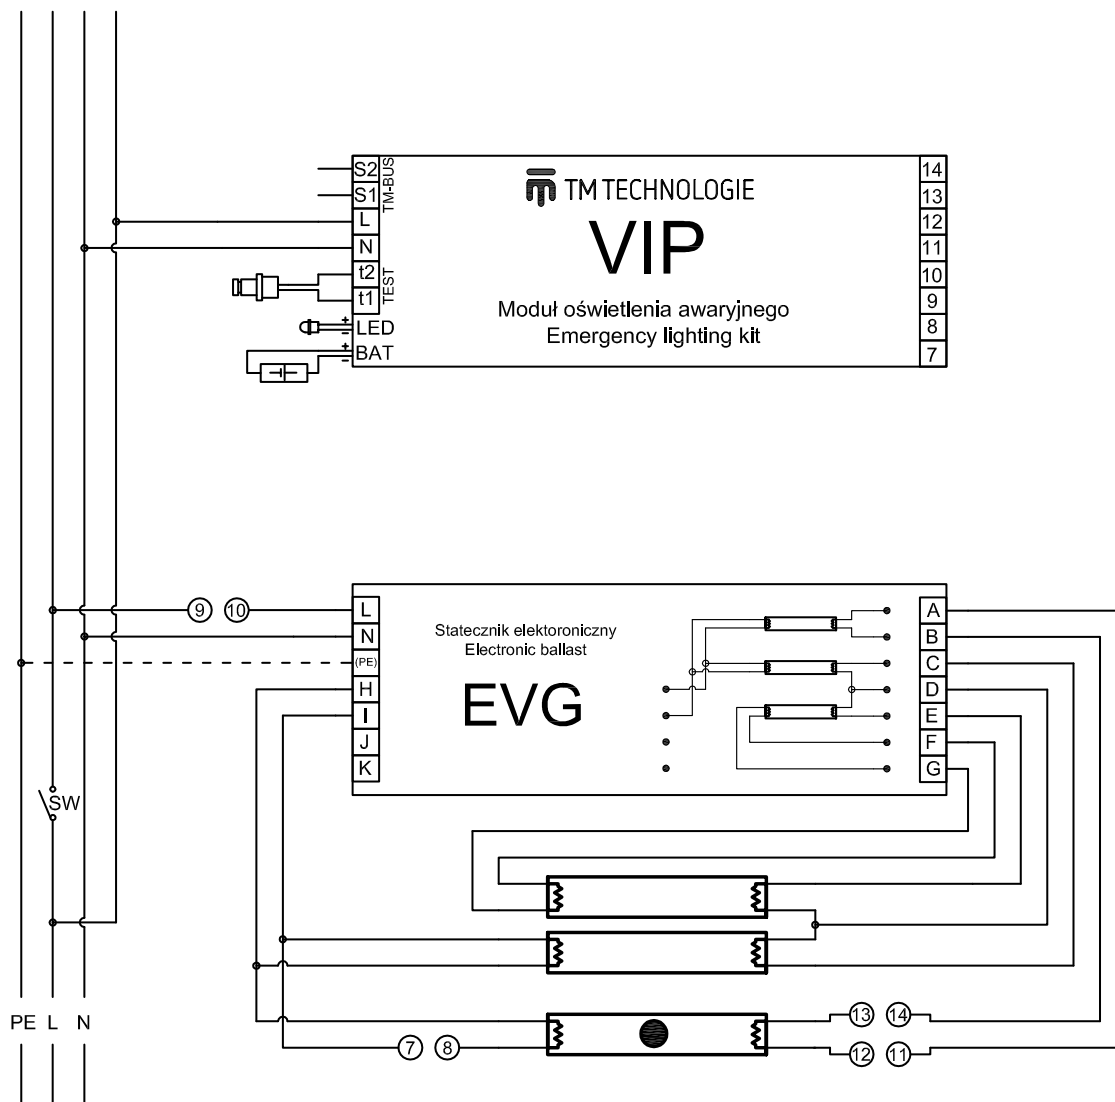

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	033	TM TECHNOLOGIE
Wersja	01/2014	

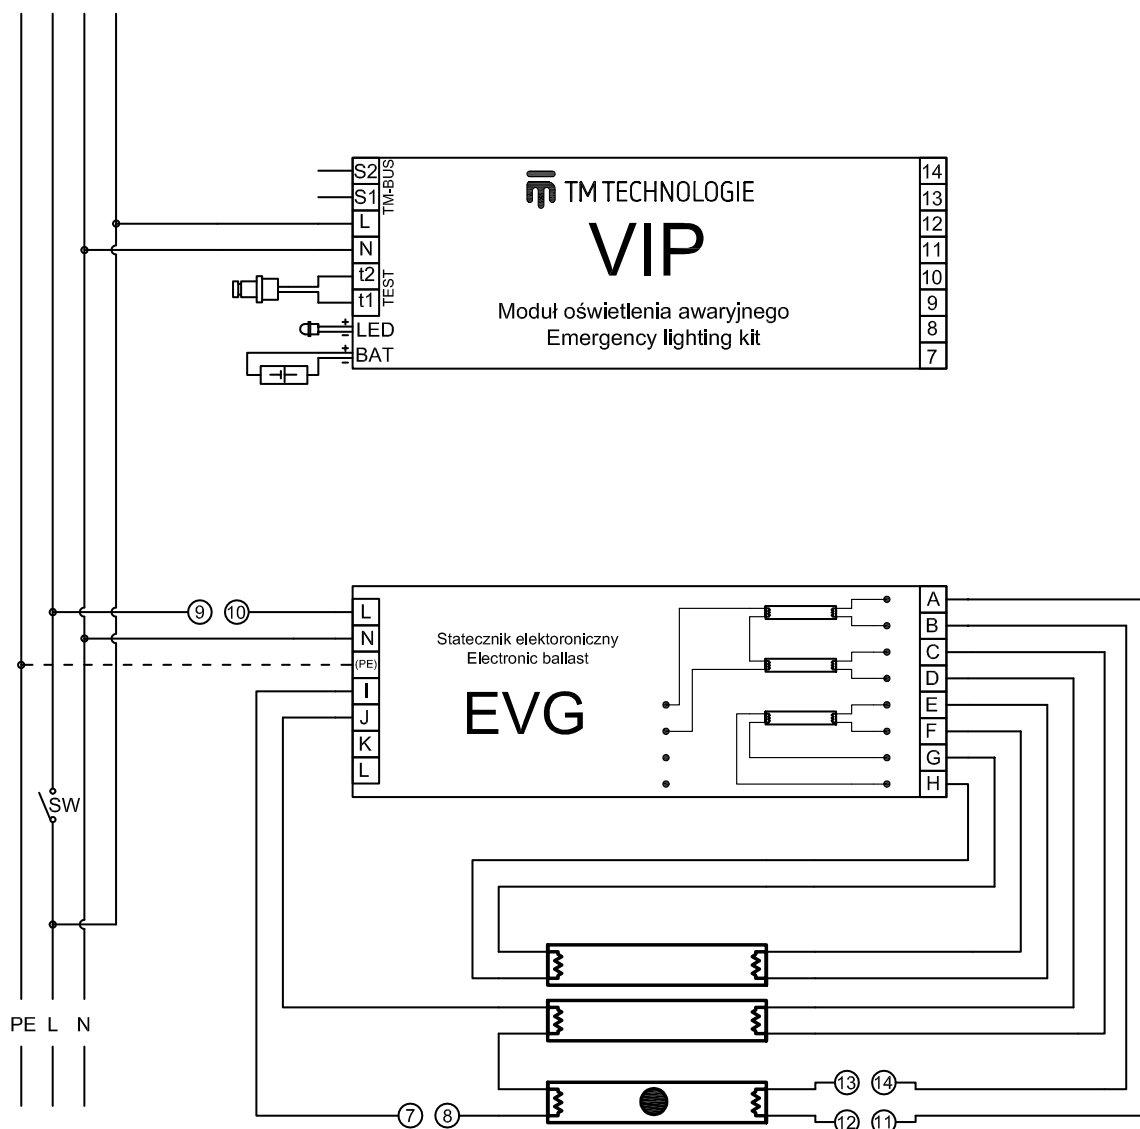

Schemat podłączenia modułów oświetlenia awaryjnego typu: Connection schema of emergency lighting kits :

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,

● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),

S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),

⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.

Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.

Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.

Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.

Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,

● - fluorescent lamp working in maintained mode,

t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)

S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),

⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.

LED diode lead -length 90 or 30 cm. Black "+", black and red "-".

Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.

During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.

All connection leads should be as short as possible.

Please read the manual of VIP emergency lighting kit carefully before use. Please test carefully your circuit after instalation. More details tel:

+48 12 444 60 60 ext. 60


NR. Schem.

034

Wersja

01/2014

TM TECHNOLOGIE

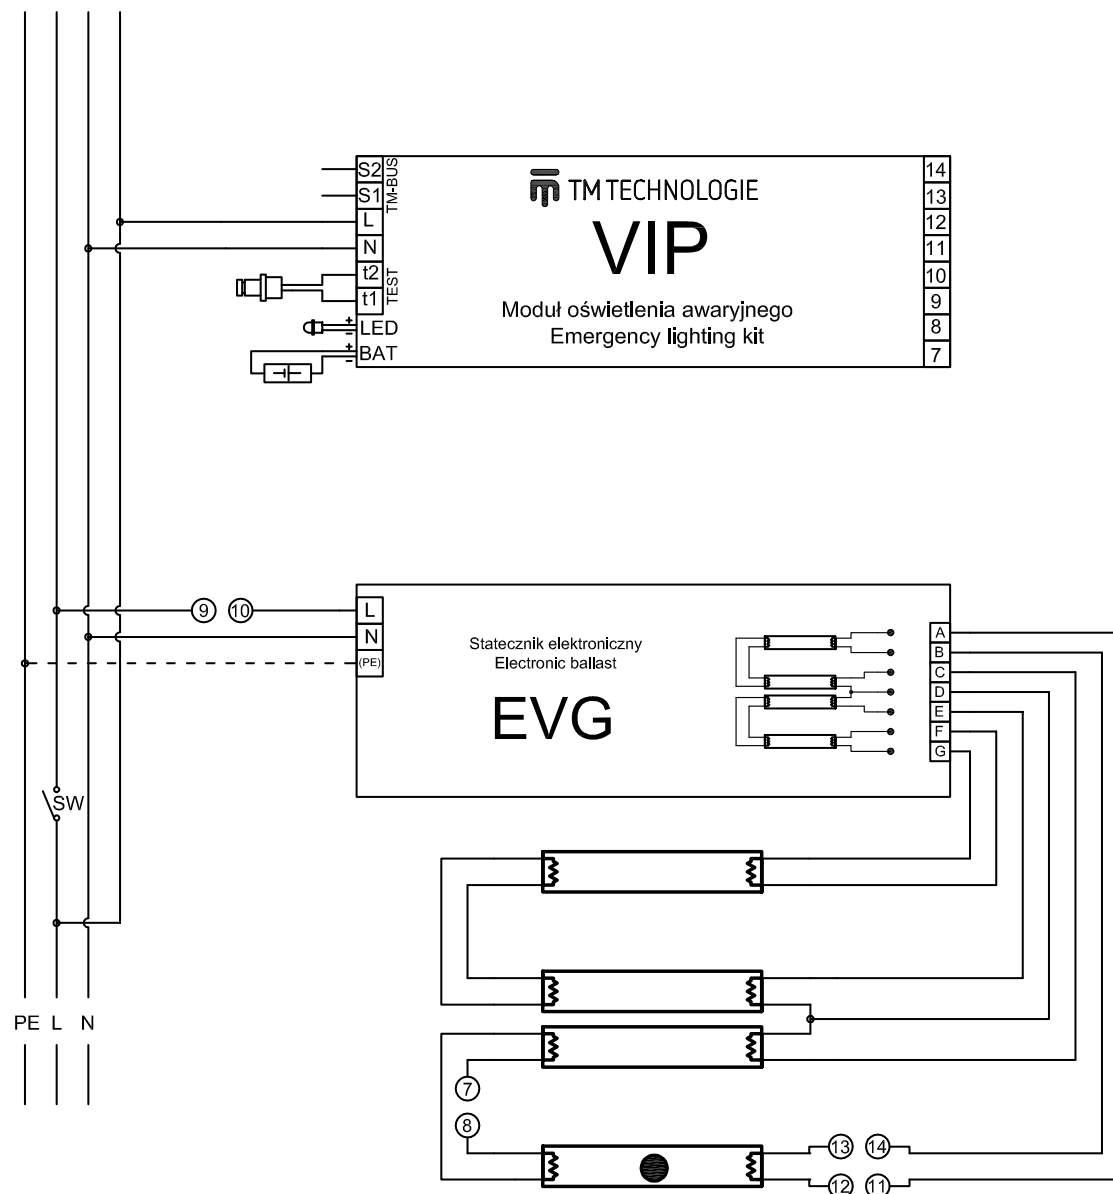

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	035	TM TECHNOLOGIE
Wersja	01/2014	

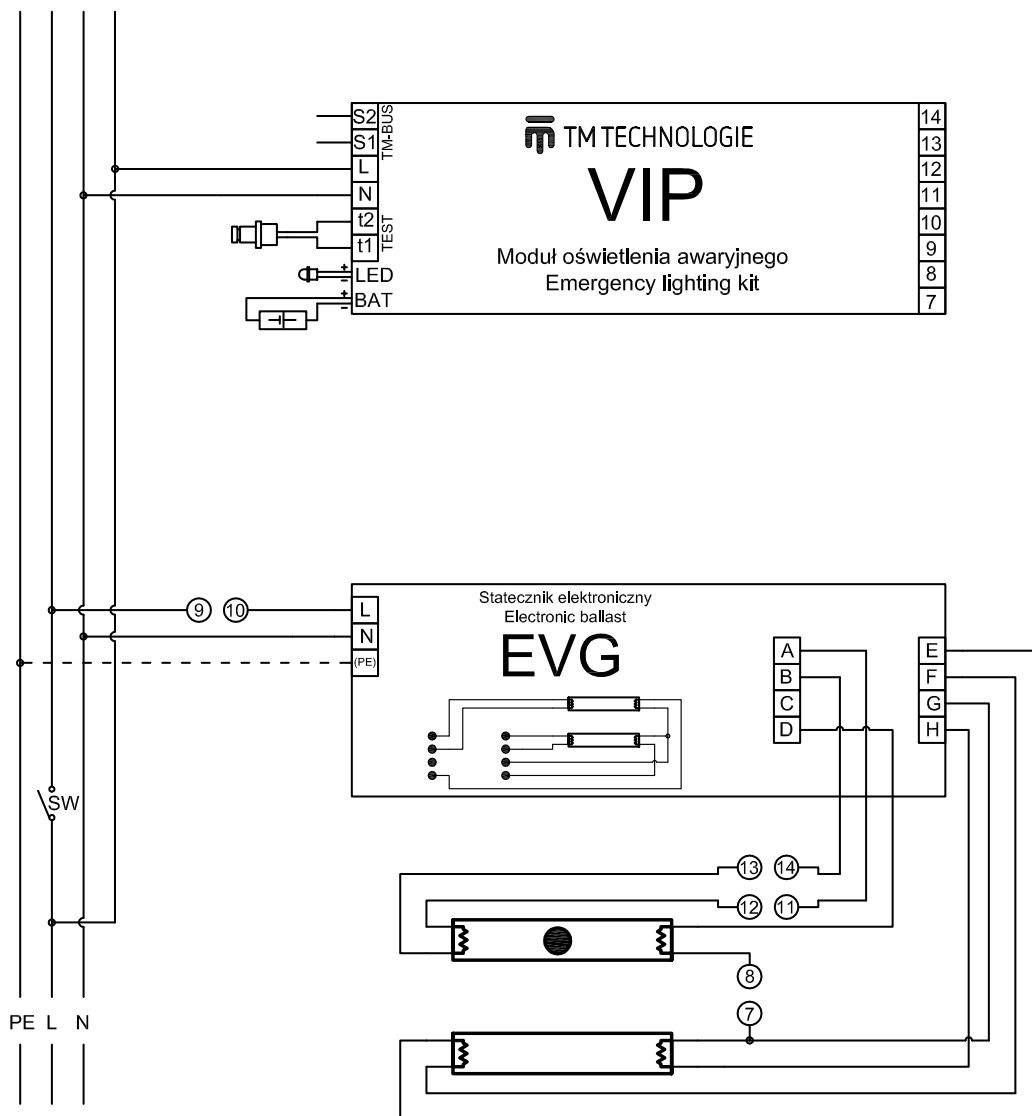

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	036	TM TECHNOLOGIE
Wersja	01/2014	

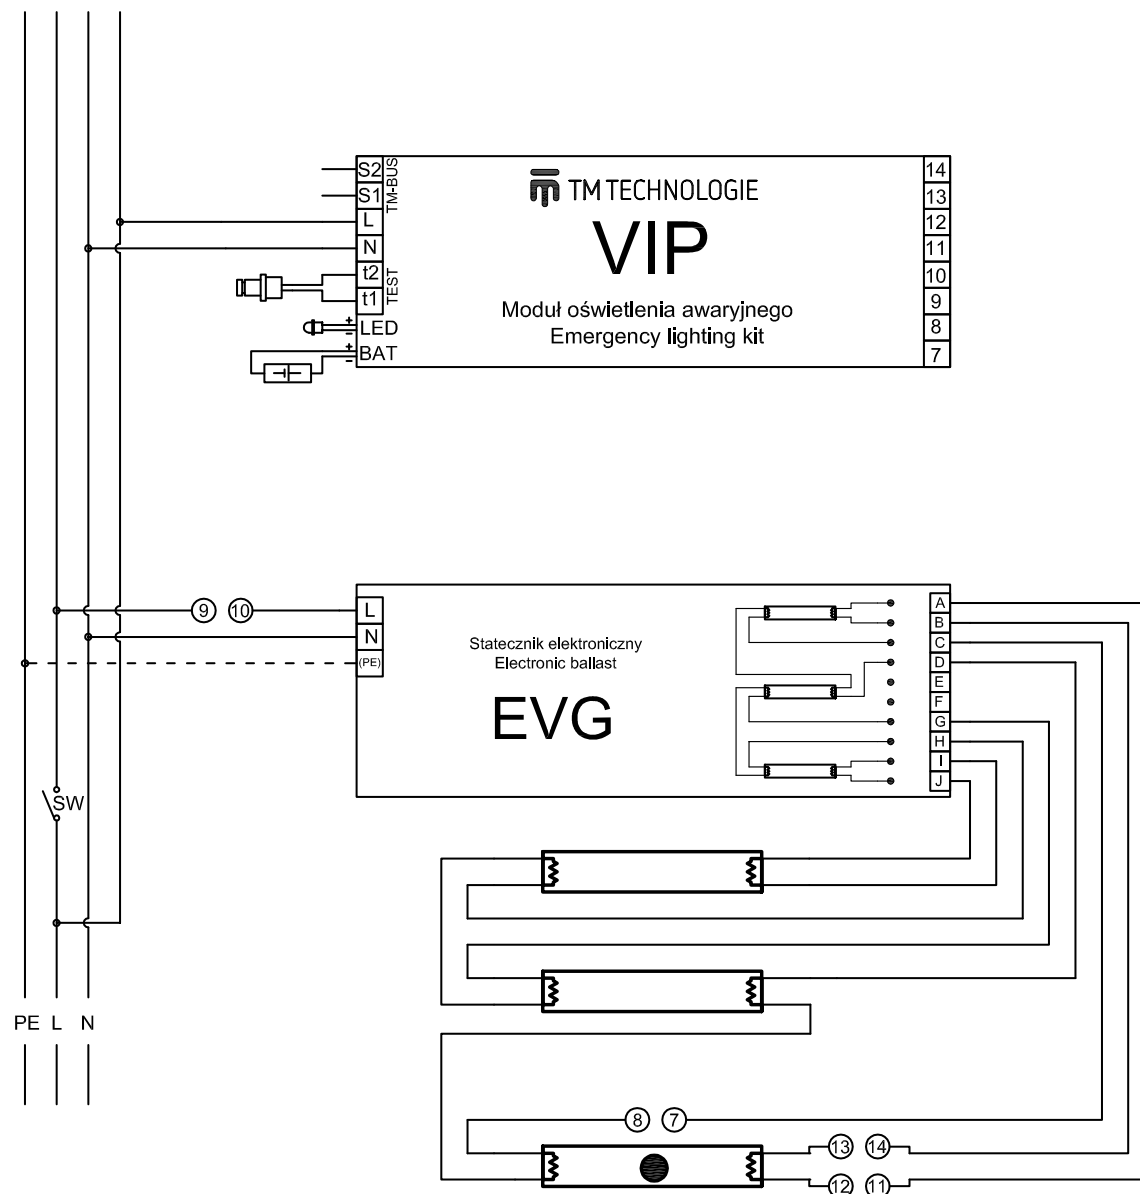

Schemat podłączenia modułów oświetlenia awaryjnego typu: Connection schema of emergency lighting kits :

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
● - świetlówka działająca w trybie sieciowo-awaryjnym,
t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
● - fluorescent lamp working in maintained mode,
t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
Accumulator's lead - length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
All connection leads should be as short as possible.
Please read the manual of VIP emergency lighting kit carefully before use.
Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	037	TM TECHNOLOGIE
Wersja	01/2014	

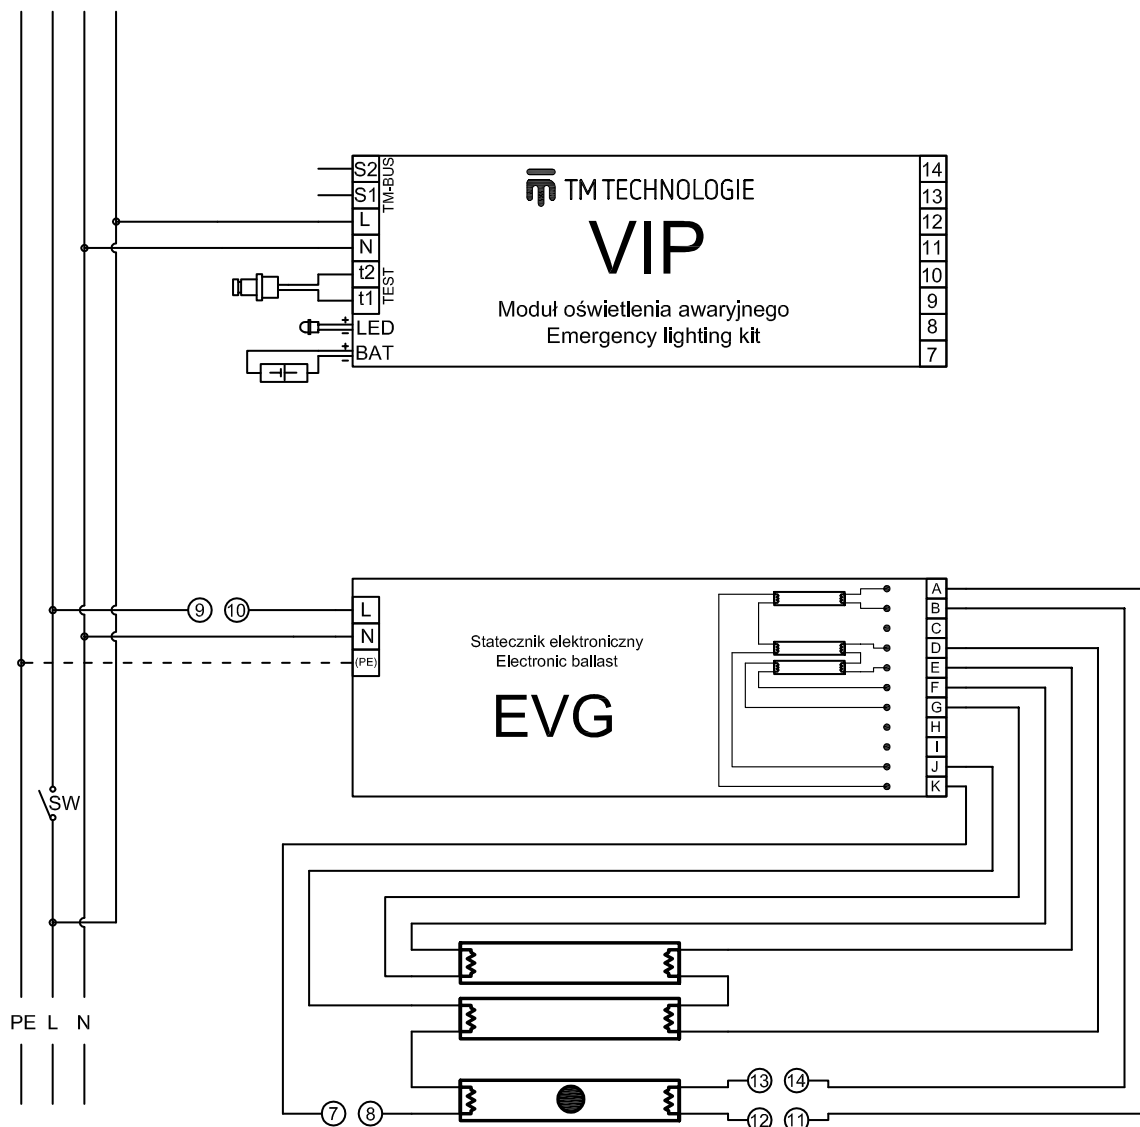

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60


Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	038	TM TECHNOLOGIE
Wersja	01/2014	

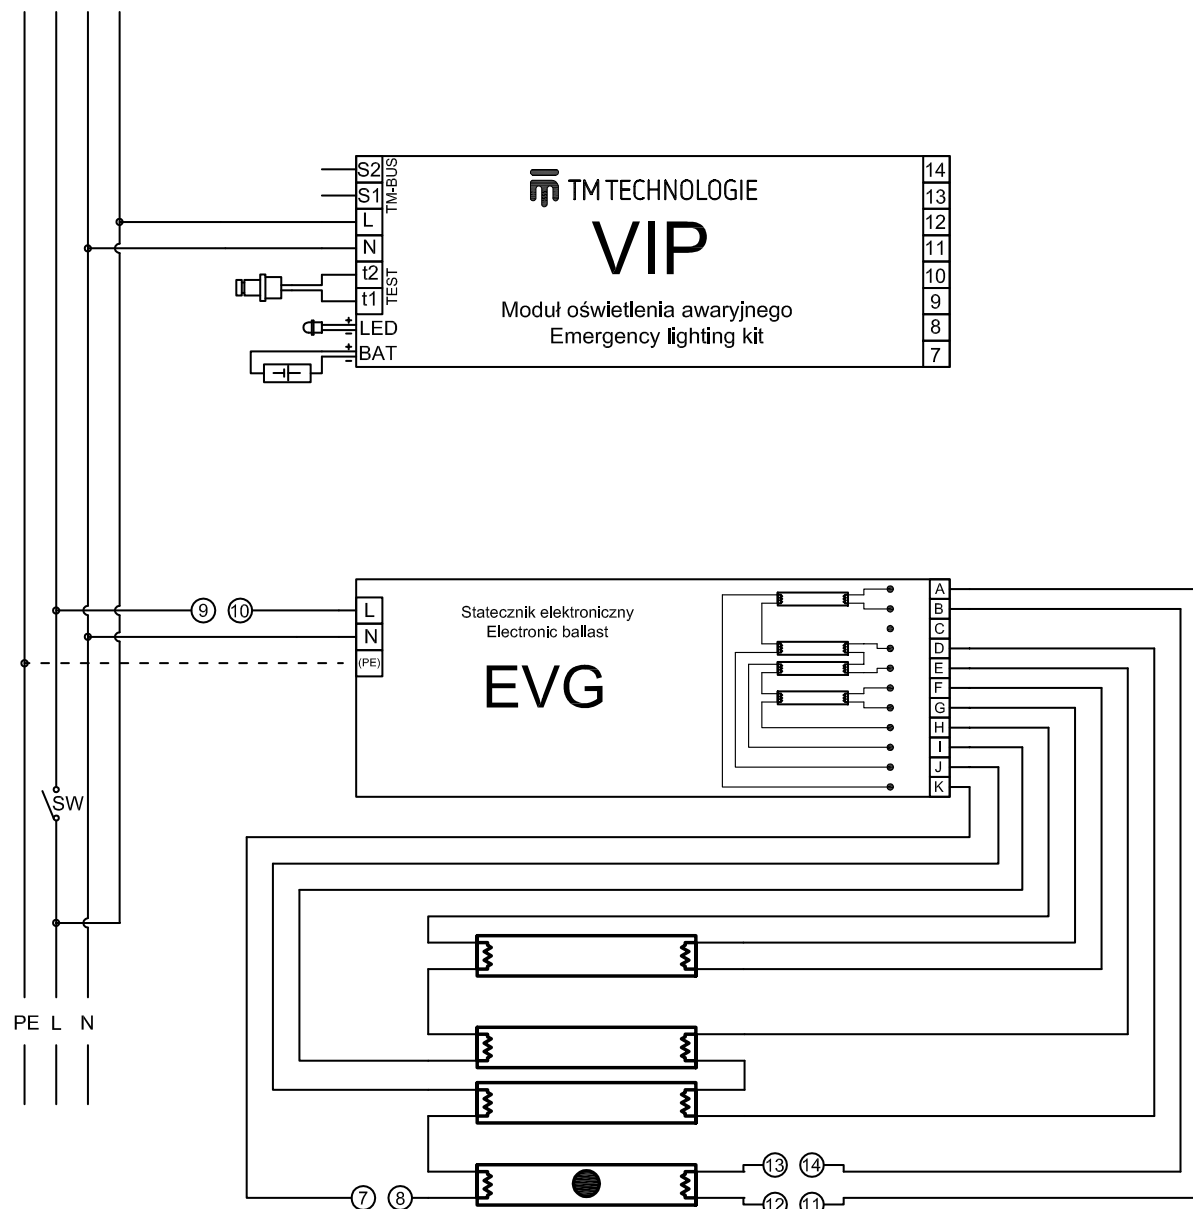

Schemat podłączenia modułów oświetlenia awaryjnego typu:
Connection schema of emergency lighting kits :

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,

● - świetlówka działająca w trybie sieciowo-awaryjnym, t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),

S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),

⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.

Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-", Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.

Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.

Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.

Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.

Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie. W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,

● - fluorescent lamp working in maintained mode,

t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)

S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),

⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.

LED diode lead -length 90 or 30 cm. Black "+", black and red "-".

Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.

During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.

All connection leads should be as short as possible.

Please read the manual of VIP emergency lighting kit carefully before use. Please test carefully your circuit after instalation. More details tel:

+48 12 444 60 60 ext. 60

NR. Schem.


039

Wersja

01/2014



TM TECHNOLOGIE

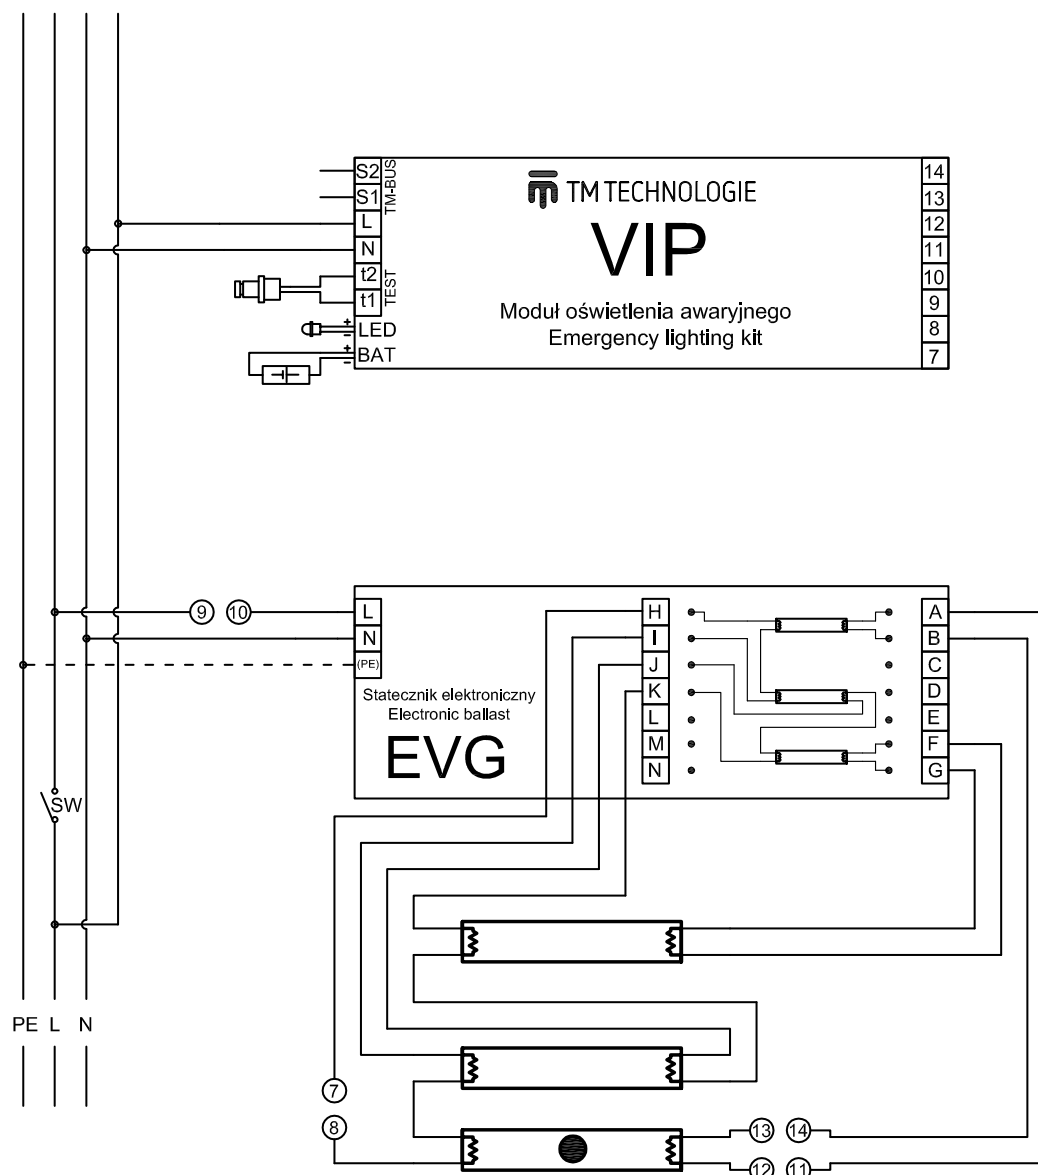

Schemat podłączenia modułów oświetlenia awaryjnego typu: **Connection schema of emergency lighting kits :**

VIP ST	
VIP ST2	✓
VIP ST i(e)	✓
VIP PRO i	✓
VIP PRO i AT	✓
VIP PRO i DATA	✓

Legenda:

PE - w zależności od modelu EVG opcjonalne przyłącze przewodu ochronnego,
 ● - świetlówka działająca w trybie sieciowo-awaryjnym,
 t1,t2 - zaciski przycisku wywołującego tryb testu (nie dotyczy modułów serii DATA),
 S1,S2 - zaciski magistrali komunikacyjnej TM-BUS (dotyczy modułów serii DATA),
 ⑧ - miejsce rozłączenia obwodu w oprawie, gdzie "8" oznacza numer zacisku modułu oświetlenia awaryjnego do którego należy podłączyć dany przewód.
 Przewód dioda LED - dł. 90 lub 30 cm. Czarny "+", czarno - czerwony "-",
 Przewód akumulatora - dł. 30 cm. Czerwony "+", czarny "-".

Uwaga!

Powyższy schemat połączeń może być niewłaściwy dla niektórych typów stateczników elektronicznych.
 Przy wykonywaniu podłączenia modułu oświetlenia awaryjnego należy przestrzegać zaleceń producenta EVG dotyczących długości przewodów przyłączeniowych.
 Wszystkie przewody przyłączeniowe powinny być jak najkrótsze.
 Przed przystąpieniem do prac zapoznaj się z instrukcją użytkownika modułu oświetlenia awaryjnego VIP.
 Prosimy o dokładne przetestowanie układu po zamontowaniu w oprawie.
 W razie pytań prosimy o kontakt pod nr: +48 12 444 60 60 wew. 60

Legend:

PE - depending on EVG model optional connection of protective lead,
 ● - fluorescent lamp working in maintained mode,
 t1,t2 - clip of the button caused test mode (not refer to DATA emergency lighting kits)
 S1,S2 - clip of communication TM-BUS (refer to DATA emergency lighting kits),
 ⑧ - place of lead disconnection in fitting, where "8" mean number of emergency lighting kit's clip to which lead should be connected.
 LED diode lead -length 90 or 30 cm. Black "+", black and red "-".
 Accumulator's lead -length 30 cm. Red "+", black "-"

Attention!

The above connection scheme might be incompatible for some types of electronic ballasts.
 During connection of emergency lighting kit, EVG manufacturer's recommendation according to length of lead should be obey.
 All connection leads should be as short as possible.
 Please read the manual of VIP emergency lighting kit carefully before use.
 Please test carefully your circuit after instalation. More details tel: +48 12 444 60 60 ext. 60

NR. Schem.	041	TM TECHNOLOGIE
Wersja	01/2014	